

ASCE/AWEA RP2011  
**Recommended Practice for  
Compliance of Large Land-based  
Wind Turbine Support Structures**



**Published by:**

American Wind Energy Association  
1501 M Street, NW, Suite 1000  
Washington, DC 20005

[www.awea.org](http://www.awea.org)

Copyright © 2011 American Wind Energy Association

And

American Society of Civil Engineers  
1801 Alexander Bell Drive  
Reston, Virginia 20191

[www.asce.org](http://www.asce.org)

**Attribution:**

No part of this Recommended Practice may be reproduced or utilized in any form without proper attribution to the American Wind Energy Association. Credit should be acknowledged as follows: "ASCE/AWEA Recommended Practice for Compliance of Large Land-based Wind Turbine Support Structures (ASCE/AWEA RP2011) © The American Wind Energy Association."

**Disclaimer**

ASCE/AWEA Recommended Practice was developed through a consensus process of interested parties administered by the American Wind Energy Association. ASCE and/or AWEA cannot be held liable for products claiming to be in conformance with this Recommended Practice.

# Recommended Practice for Compliance of Large Land-based Wind Turbine Support Structures

*For Public Release*

<b>AWEA/TC or SC:</b> Large Wind Turbine Compliance Guideline Committee	
<b>Title of Project Team:</b> ASCE/AWEA Committee	<b>Date of circulation:</b> 12/25/2011
<b>Websites where this document can be found:</b> <a href="http://www.awea.org">www.awea.org</a> <a href="http://www.asce.org">www.asce.org</a>	
<b>Also of interest to the following committees:</b> ASCE Structural Wind Engineering Committee ASCE Wind Energy Structures Subcommittee	<b>Supersedes document:</b> None
<b>Functions concerned:</b> <input checked="" type="checkbox"/> Safety <input type="checkbox"/> EMC <input type="checkbox"/> Environment <input checked="" type="checkbox"/> Quality Assurance	

**ASCE/AWEA**

**Wind Turbine Structures:**

**Recommended Practice for Compliance of Large  
Land-based Wind Turbine Support Structures**

**December 2011**

## Acknowledgements

ASCE/AWEA RP2011 - Committee Chair  
 AWEA Large Turbine Compliance Committee Chair  
 AWEA Standards Development Board Chair  
 ASCE Codes and Standards Director  
 AWEA Senior Technical Programs Manager

Rolando E. Vega, ABS Consulting  
 Paul Veers, National Renewable Energy Laboratory  
 Suzanne Meeker, GE Energy  
 Paul Sgambati, American Society of Civil Engineers  
 John Dunlop, American Wind Energy Association

### ASCE/AWEA RP2011- Committee Leaders

Committee Secretary  
 Permitting Subcommittee Leader  
 Loads and External Conditions Subcommittee Leader  
 Tower Subcommittee Leader  
 Foundations Subcommittee Leader  
 Fabrication, Installation and Operations Subcommittee Leader  
 Terms and Definitions Leader

Leonardo Dueñas-Osorio, Rice University  
 Kevin Smith, DNV Renewables  
 Rolando E. Vega, ABS Consulting  
 Nestor Agbayani, Agbayani Structural Engineering  
 Craig Moller, GL Garrad Hassan America, Inc.  
 Jim Lockwood, Aero Solutions, LLC  
 Chris Martin, Glenn Martin

### ASCE/AWEA RP2011 - Working Group

Joel Bahma, Barr Engineering Company  
 David Brinker, Rohn Towers  
 Luis Carbonell, Siemens Wind Power  
 Christof Dittmar, RePower USA  
 John Eggers, Vestas  
 Shu-Jin Fang, Sargent and Lundy  
 Albert Fisas Camañes, ALSTOM  
 Bill Holley, GE Energy  
 Thomas Korzeniewski, PowerWind GmbH

Mark Malouf, Malouf Engineering  
 Lance Manuel, University of Texas, Austin  
 Emil Moroz, AES Wind  
 Jim Newell, Degenkolb  
 Steve Owens, Clipper Windpower Technology  
 Ian Prowell, Missouri S&T  
 Brian Reese, ReliaPOLE Inspection Services Company  
 Shelton Stringer, Earth Systems Global, Inc.  
 Tomas Vasquez, Sargent and Lundy

### ASCE/AWEA RP2011 - Contributing Members

Jim Albert, Stress Engineering  
 Michelle Barbato, Louisiana State University  
 Jomaa Ben-Hassine, RES Americas  
 Jack Bissey, ESAB Welding and Cutting  
 Lisa Brasche, Iowa State University  
 Sandy Butterfield, Boulder Wind Power  
 Matthew Chase, Vestas Technology R&D  
 Brad Clark, Larimer County Community College  
 Jerry Crescenti, Iberdrola Renewables  
 Mike Cronin, Intertek - Aptech  
 Michael R. Derby, Department of Energy  
 John Erichsen, EET LLC

Jon Galsworthy, RWDI, Inc.  
 Andrew Golder, Gamesa Wind US  
 Allan Henderson, Patrick & Henderson  
 Daniel Howell, FM Global  
 Michelle Huysman, Oak Creek Energy  
 Brian Kramak, AWS TruePower  
 Nina Kristeva, GE Energy - Wind Towers  
 Clayton Lee, Intertek  
 Chris Letchford, Rensselaer Polytechnic Institute  
 Colwyn Sayers, GE Energy  
 Case van Dam, University of California at Davis  
 Delong Zuo, Texas Tech University

### ASCE/AWEA RP2011 - Technical Review Panel

Robert Bachman, Tobolski/Watkins Engineering  
 Leighton Cochran, CPP, Inc.  
 Michael Derby, U.S. Department of Energy  
 John Fisher, Lehigh University  
 George Frater, Canadian Steel Construction Council  
 Rudolph Frizzi, Langan Engineering & Env Svcs  
 Marcelino Iglesias, State of New Jersey  
 David Kerins, ExxonMobil Research & Engineering  
 Gary Klein, Wiss Janney Elstner Associates

Kishor Mehta, Texas Tech University  
 Shankar Nair, Teng & Associates, Inc.  
 Ronald Randle, EDM International, Inc.  
 Jim Rossberg, American Society of Civil Engineers  
 Ted Stathopoulos, Concordia University  
 Joe Stevens, AES Wind  
 Andrew Taylor, KPFF  
 Shin Tower Wang, Ensoft, Inc.

## Table of Contents

1	Preface .....	4
2	Introduction and Purpose.....	5
3	Terms and Definitions.....	7
4	Principal Elements of Permitting, Design and Quality Assurance .....	10
4.1	General .....	10
4.2	Coordination of International and U.S. Standards .....	12
4.2.1	Conflicting Standards .....	12
4.2.2	Design Standards .....	14
4.2.3	Quality Assurance/Quality Control .....	14
4.3	Component Classifications .....	15
4.4	Occupancy Category .....	15
5	External conditions and loads .....	17
5.1	General .....	17
5.2	Wind turbine classes .....	17
5.3	External conditions required for assessment .....	18
5.3.1	Normal Wind speed probability distribution .....	18
5.3.2	Normal wind profile model (NWP) .....	18
5.3.3	Normal turbulence model (NTM) .....	19
5.3.4	Extreme wind speed model (EWM) .....	19
5.3.5	Extreme operating gust (EOG).....	20
5.3.6	Extreme turbulence model (ETM) .....	20
5.3.7	Extreme direction change (EDC).....	20
5.3.8	Extreme coherent gust with direction change (ECD) .....	20
5.3.9	Extreme wind shear (EWS).....	20
5.3.10	Other environmental conditions .....	21
5.4	Loads and load calculations .....	21
5.4.1	General .....	21
5.4.2	Wind turbine modelling and loading considerations.....	22
5.4.3	Design situations and loads cases .....	23
5.4.4	Seismic loading and design criteria .....	29
5.4.5	Assessment of soil conditions .....	32
5.4.6	Assessment of Wind Loads Applied Along the Tower Mast .....	34
5.4.7	Assessment of Frequency Separation.....	34
5.4.8	Assessment of structural integrity by reference to wind data.....	35
5.4.9	Assessment of structural integrity by load calculation with reference to site-specific conditions .....	36
6	Materials .....	37
7	Tower Support Structure.....	38
7.1	Materials .....	38
7.2	Strength Design .....	39

7.2.1	Compressive Strength .....	40
7.2.2	Shear Strength .....	41
7.2.3	Torsional Strength .....	42
7.2.4	Combined Torsion, Flexure, Shear and/or Axial Force .....	43
7.3	Fatigue Strength.....	43
7.3.1	S-N Curves.....	44
7.3.2	Strength Resistance Factors.....	45
7.3.3	WTGS Simulations .....	45
7.3.4	Miner's Rule Summation.....	46
7.3.5	Damage Equivalent Loads .....	46
7.4	Special Analysis by Finite Element Analysis (FEA) Methods .....	48
7.4.1	Top Flange Eccentricity Analysis .....	48
7.4.2	Hotspot Analysis at Shell Penetrations .....	49
7.4.3	Buckling Analysis .....	49
7.4.4	Section Splice Connections .....	49
7.5	Tower Internal Components.....	49
7.5.1	Connections to the Tower Wall .....	50
7.5.2	Platforms.....	50
7.5.3	Ladders .....	50
7.5.4	Stairs, Handrails, and Guardrails .....	50
7.5.5	Other Support Framing .....	50
7.5.6	Tuned Mass Dampers.....	50
7.5.7	Internal Chambers .....	50
7.6	Inspection and Testing Requirements .....	50
7.7	Coordination with Local Building Code .....	51
7.7.1	General .....	51
7.7.2	Drift limits .....	51
7.8	Structural Performance under Fire-Exposed Conditions.....	52
8	Foundations .....	53
8.1	Materials .....	53
8.2	Limit States .....	53
8.2.1	Load Factoring .....	54
8.2.2	Ultimate Limit States .....	54
8.2.3	Serviceability Limit States.....	54
8.2.4	Fatigue Limit States.....	54
8.3	Anchorage.....	54
8.3.1	Embedded Anchorages.....	55
8.3.2	Bolted Anchorages .....	55
8.3.3	Anchorage load transfer .....	56
8.4	Reinforced Concrete Design.....	57
8.5	Fatigue Analysis.....	57
8.6	Considerations Specific to Certain Types of Foundations .....	57
8.6.1	Shallow Foundations .....	57
8.6.2	Deep Foundations .....	59

8.6.3	Rock and Soil Anchored Foundations .....	61
9	Fabrication and Installation.....	64
9.1	Scope.....	64
9.2	Tower Fabrication and Installation .....	64
9.2.1	Fabrication Tolerances .....	64
9.2.2	Tower Installation .....	66
9.3	Foundation Construction .....	68
9.3.1	Concrete and Grout .....	69
9.3.2	Concrete Durability Requirements .....	69
9.3.3	Anchor Bolts .....	69
9.3.4	Reinforcement .....	69
9.3.5	Concrete Placement .....	69
9.3.6	Geotechnical Testing .....	69
9.3.7	Concrete Testing .....	70
9.3.8	Anchor Bolt Tensioning.....	70
10	Operations, Inspections and Structural Health Monitoring .....	71
10.1	Scope.....	71
10.2	Commissioning Activities .....	71
10.3	Post Construction Inspections – Towers .....	71
10.3.1	Tower Structure .....	71
10.3.2	Bolted Connections .....	71
10.3.3	Welded Connections.....	72
10.3.4	Corrosion Protection and Coatings .....	72
10.4	Post construction Inspections - Foundations.....	72
10.5	Structural Health Monitoring .....	73
10.6	Life Cycle .....	73
11	References.....	74
12	Appendix A: Large Wind Turbine Structural Compliance Checklist .....	77
13	Appendix B: Loads Document Sample Format .....	78
14	Appendix C: ASCE 7-05 versus IEC 61400-1 extreme velocity and turbulence profiles ...	80



# 1 Preface

With the objective of capturing and assuring that this *Recommended Practice* document serves the need of the industry a survey and outreach team was formed to develop a survey, collect and analyze professional judgment and experience of a much larger group that included Authorities Having Jurisdiction from throughout the nation. The Summer 2010 survey was developed to have a better understanding and perspective of Authorities Having Jurisdiction with regards to: (1) permitting challenges, (2) key issues which the Project Team members may not be aware, and (3) understand the level of knowledge that exists among Authorities Having Jurisdiction with respect to wind turbine standards.

The survey received 170 responses from respondents located in 39 states. The responses were considered very helpful for capturing different regional perspectives. The survey was carried out with an online form and followed an anonymous procedure to foster objective discussion. While a larger statistical sample of the industry would have been more ideal, nevertheless, feedback obtained from this survey was valuable, discussed within the Project Team members and considered in the development of this Recommended Practice document.

The two largest groups that provided responses to the survey were Authorities Having Jurisdiction (54%) and Building Inspectors (20%) accounting for 74% of all respondents. Responses were also received from individuals identified in the other groups; specifically, Developers/Owner/Operator; Manufacturers; Design Engineers, Financier/Investors; and Others.

The developers of this Recommended Practice are considering pursuing the creation of a consensus standard with the intent that this standard would be adopted by reference into the model building codes (e.g. the International Building Code). *ASCE is an American National Standards Institute (ANSI) accredited Standards Development Organization (SDO)*. The future standard would be developed in accordance with *ASCE Rules for Standards Committees (the Rules)* and the *ASCE Standards Writing Manual* based on the *ANSI Essential Requirements: Due process requirements for American National Standards*. The steps for developing a consensus Standard is briefly outlined in the following simplified flowchart, in accordance with the Memorandum of Understanding (MOU) between ASCE and AWEA.

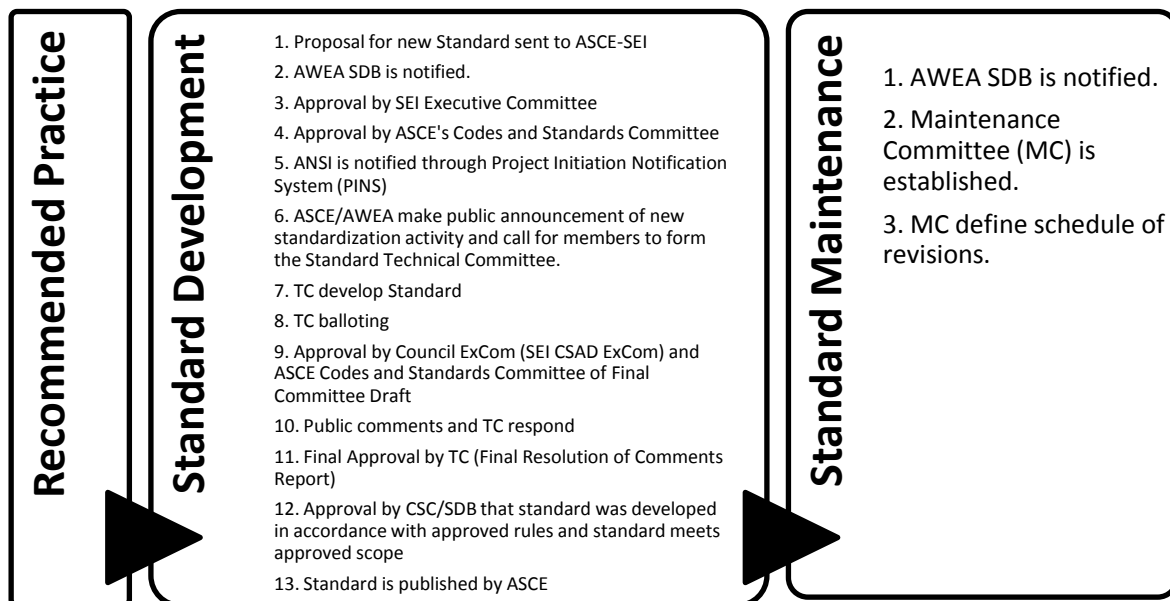


Figure 1-1: Simplified process illustration for developing a national consensus Standard on wind turbine tower and foundation structures

## 2 Introduction and Purpose

The *Recommended Practice for Compliance of Large Land-based Wind Turbine Support Structures* details prudent recommendations for designs and processes for use as a guide in the design and approval process in order to achieve engineering integrity of wind turbines in the U.S. The purpose of this document is to:

- Enable those responsible for the permitting process to achieve consistency by clarifying the relevant and appropriate standards that have been used in the design process and should be applied when assessing structural capacity, and
- Insure that wind turbine structures so permitted have an appropriate minimum level of protection against damage from hazards during the planned lifetime.

Wind turbines are constructed for the purpose of electricity generation, and are therefore elements of electrical power plants that operate in conjunction with the electrical infrastructure as a cohesive unit. They are built in diverse locations, often remote or rural, widely distributed across the United States in various legal jurisdictions. Since they are not buildings, bridges, or structures typically granted permits in many areas, the support structures for the turbines can be governed by design criteria that are not familiar to the Authorities Having Jurisdiction (AHJs) for providing construction and operating permits. There is a need to clarify the process of establishing the structural integrity of wind plants built in diverse local jurisdictions.

The American Wind Energy Association (AWEA) Standards Development Board has authorized a committee to develop documents that clearly identify typical and specific U.S. national wind turbine design recommendations that are compatible with the International Electrotechnical Commission [IEC, 2005] requirements and to provide recommendation where IEC 61400-1 and U.S. practice differs. An organizing meeting of all interested parties was hosted by the National Renewable Energy Laboratory (NREL) on October 27-28, 2009. As a result of the meeting three main project teams – Structural, Offshore and Electrical – were identified to investigate the gaps and develop guidelines that address the needs of the industry. This *Recommended Practice for Compliance of Large Land-based Wind Turbine Support Structures* is the outcome of the Structures Project Team. The Offshore and Electrical project teams are publishing guiding documentation separately since there is very little overlap in permitting needs between topic areas.

International standards are already in place by which turbines are designed and which are therefore used to evaluate their structural adequacy. Almost all large wind turbines available on the market today have been certified or otherwise objectively evaluated by an international certification body through a comprehensive evaluation, testing, and manufacturing quality review process. When these turbines are introduced into the U.S. market, they must also satisfy local structural and electrical permitting requirements. Since there may be more than one standard against which a turbine is evaluated, this document also attempts to clarify the overlaps or fill the gaps between alternate standards, as well as local practice. The beneficiaries of this document are intended to be the local AHJs, by providing clarity in wind turbine structural requirements, and the developers, who must design the plant to meet local expectations, manage the construction to meet those plans, and provide appropriate supporting documentation.

This Recommended Practice is concerned with the loading and structural dynamics of Land-based wind turbine support structures. It therefore deals with subsystems that affect the response of the structural system, including control and protection mechanisms, internal electrical systems, mechanical systems, support structures (tower and foundation) and geotechnical considerations. This document provides general guidance on identification of criteria and parameters used for site evaluation, turbine selection, site-specific design, construction, *Commissioning* and monitoring of wind plants. It deals with large, utility scale machines, which are defined in the IEC Standards as turbines with rotor swept areas larger than 200 square meters.

To be effective, this Recommended Practice document must be used together with the appropriate IEC and other international standards mentioned in this document, as well as U.S. Standards, including AISC, ACI 318, and ASCE 7. *Strength design* of steel components may be similar to or in accordance with AISC's Load and Resistance Factor Design (LRFD) [AISC, 2005]. Strength design of concrete components may be similar to or in accordance with ACI 318 [ACI 318, 2008]. A Load and Resistance Factor Design (LRFD) approach is adopted, except where serviceability limit states or other design assessments require unfactored or working stress loads.

The *Recommended Practice for Compliance of Large Land-based Wind Turbine Support Structures* was developed in conjunction with the Wind Energy Structures subcommittee of the American Society of Civil Engineers (ASCE) Structural Wind Engineering Committee. All together, the Structures Project Team consists of fifty members from Academia, Research Laboratories, Certification Bodies, Consultants and Designers, Manufacturers and Professional Societies. In addition, internal and external review panels, adding seventeen technical experts representing U.S. and Canadian Standards were engaged in the process with the objective to obtain a high level of technical accuracy in the recommendations.

### 3 Terms and Definitions

**AISC Provisions Specification:** General term to refer to the steel design provisions contained in the American Institute of Steel Construction's (AISC) standard titled ANSI/AISC 360-05 *Specification for Structural Steel Buildings* as contained in the *AISC Steel Construction Manual* [AISC, 2005].

**Authority Having Jurisdiction (AHJ):** The governmental agency or local building official with regulatory authority to issue structural permits for the project site.

**Certification Agency:** An agency that carries out type (equipment) or project (site-specific) certification of wind turbines and its components on the basis of specific IEC Standards or guidelines. In this context "certification" refers to commercial certification usually by a non-governmental third-party agency and should not be misconstrued to mean approval stamping by a Professional Engineer (PE) or approval by *AHJ* plan review, both of which are regulatory approval processes sometimes referred to as "engineering certification".

**Certification Agency Guidelines:** The design standards or guidelines that serve as the *Certification Agency's* basis of certification. Any references herein to the design provisions of particular *Certification Agency Guidelines* should not be construed as commercial endorsement of the associated *Certifying Agency*.

**Commissioning:** Quality-based process with documented confirmation that wind turbine systems are tested, balanced, operated and maintained in compliance with the owner's project requirements. *Commissioning* requirements for the Wind Turbine are typically defined by the *Wind Turbine Manufacturer*.

**Complex terrain:** terrain with significant variations of terrain topography failing to meet indicators shown in Section 5.4.3.8.1.

**Component Class:** Safety classification assigned for the design of wind turbine components based on its failure consequence, as more specifically described in Section 4.3.

**Contractor:** Any group procured to provide various services related to the development of Wind Turbine Generator System (WTGS).

**Cut-in and Cut-out Speeds:** The relative wind speed at which the wind turbine starts and stops operating for generation of power, respectively.

**Developer:** A group or entity responsible for forming and closing all business transactions related to the design, build and establishment of wind turbine facilities. Responsibilities generally extend from initial due diligence, land purchase, purchase power negotiation and project financing to final *Commissioning* of the system. Responsible sub parties are hired by the developer to complete these tasks with supervision maintained by the developer.

**Engineer:** The designer or the engineer with design or inspection authority. Where required by the *local building code* or *AHJ*, the *Engineer* is a Registered Design Professional (RDP), such as a licensed Professional Engineer (PE) and/or Structural Engineer (SE), or the Engineer of Record (EOR) for the permit.

**Fabricated Tube:** A circular steel tube created from forming flat plate into cylindrical or tapered ring segments called "cans." Cans are joined by circumferential (girth) welds to form longer tube sections. Fabricated tubes used in large utility-scale Wind Turbine Generator System (*WTGS*) towers are in almost all cases thin-shell structures with high outside diameter-to-wall thickness ratios (i.e., "*D/t* ratios").

**Field Contractor:** Company or companies responsible for the installation of the Tower or Foundation elements and the required bolted, field welded or grouted connections to secure the structural system and components not pre-installed to the Tower by the Fabricator.

**Foundation:** Wind Turbine Generator System (*WTGS*) structural support system located below grade and responsible for transferring load to the subsoil. Geotechnical subsoil properties govern sizing of this structural support system. Details included in the foundation support system include the anchoring system from the tower to subgrade support system. Generally reinforced concrete incorporated with spread or pile footings, or other concepts as developed by a licensed Professional Registered *Engineer* based on the geotechnical conditions that exist.

**Horizontal Axis Wind Turbine (HAWT):** A wind turbine configuration with the plane of the rotor blades perpendicular to the wind direction and with the axis of rotation of the main rotor shaft lying in the horizontal plane.

**Hotspot:** A *stress concentration* for a welded joint. An area of localized high stress due to the effect of a stress riser such as a geometric discontinuity. The term “hotspot” does not imply a thermal characteristic but rather denotes the appearance of high stress concentration in an FEA color contour stress plot, especially using the common color contouring convention where red color represents the highest stress intensity.

**Independent *Engineer*:** Generally an independent engineer will provide peer review or specific verification on a component or site-specific conditions of the system in question.

**Loads Document:** A report generated by the turbine manufacturer that summarizes all or primary Wind Turbine Generator System (*WTGS*) governing loads in compliance with IEC Standards or *Certification Agency Guidelines*, and as applicable to the design of the component under consideration.

**Local Building Code:** The building code enforced by the *AHJ* for structural permitting. In the absence of a *local building code*, the International Building Code (IBC) [IBC, 2009] may be used to represent *local building code* requirements.

**Owner:** Owner and developer may be or may not be synonymous. For this documents purpose we will assume the developer is working on behalf of the owner.

**Project:** Refers to all components and activities related to the development of wind generation. The project is generally managed by the developer.

**Recommended Practice:** this document.

**Reference wind speed:** Wind speed averaged over 10-minutes at hub height as designated for wind turbine classes.

**Standard Wind Turbine Class:** Wind turbine that has prescribed parameter values for reference wind speed, turbulence, temperature range, humidity etc., as indicated in Section 5.

**Strength Design:** A method of proportioning structural components by applying design load factors to the demand loads and reducing the component strength by applying capacity reduction factors. While the choice of design methodology rests with the *Engineer*, it is useful to observe that much of the international structural steel design practice based on the Eurocodes has long been in a strength design format. In contrast, working stress design remains in use in some structural and mechanical engineering standards in the U.S.

**Support Structure:** See *Tower* and *Foundation*.

**Tower Fabricator:** Business enterprise responsible for fabricating tower portion of the structural support system. Fabricators can build towers to *Turbine Manufacturers* design and specifications

or Fabricators may be responsible to design tower to meet *Turbine Manufacturers* loading specifications.

**Tower:** Typically the Wind Turbine Generator System (*WTGS*) structural system mounted to the foundation and supporting the Wind Turbine. In cases where a short tube section is used as a tower top adapter or yaw adapter in connection with turbine mounting, the adapter may be classified as either part of the turbine or as part of the tower at the discretion of the *Engineer*, except that any adapter section greater than two meters in length should be considered part of the tower. Towers as classified by this definition are open to the discretion of the designer with regards to material type and geometric configuration. Generally towers supplied for *WTGS* applications are fabricated tube structural support systems.

**Turbine Manufacturer:** Business enterprise responsible for design, manufacture, delivery and sale of Wind Turbine Rotor-Nacelle Assembly components and in some cases the Tower. Turbine Manufacturer is responsible for establishing loads (both static and dynamic) and moments generated by the Wind Turbine Rotor-Nacelle Assembly transferred through the tower top adapter system.

**Vertical Axis Wind Turbine (VAWT):** A wind turbine configuration where the main shaft's axis of rotation is vertical. This is in contrast to a Horizontal Axis Wind Turbine (*HAWT*). *VAWT* configurations such as the Darrieus type wind turbine are not within the scope of this *Recommended Practice document*.

**Wind Energy Conversion System (WECS):** See *Wind Turbine Generator Systems (WTGS)*.

**Wind Turbine Generator System (WTGS):** An electricity-generating system consisting of a wind turbine generator elevated by mounting it on top of a *support structure* consisting of a tower and foundation. The most common example of a *WTGS* configuration addressed by this *document* is a 3-bladed upwind *HAWT*.

**Wind Turbine:** Consists of blades, hub, nacelle, yaw system, internal drivetrain, and electrical generator equipment. Also referred in this document as Rotor-Nacelle Assembly (RNA).

**Wind Turbine Class:** Identification of wind turbine category used in design to meet the wind conditions defined in Table 5-1.

**Wind Turbine Component Class:** See *Component Class*.

## 4 Principal Elements of Permitting, Design and Quality Assurance

### 4.1 General

The general flow for development of wind farms can be summarized in seven steps:

1. Site evaluation
2. Wind turbine selection
3. Site-Specific design
4. Permitting
5. Construction
6. Commissioning
7. Monitoring and Maintenance

This can be illustrated in more detail by the flowchart shown in Figure 1. A site evaluation is used to identify wind resource potential, necessary road access, transmission system availability, wind farm layout, community acceptance and other environmental considerations that may be required by permitting authorities. This evaluation should take into account both historical site-specific and non site-specific environmental data, as necessary. The environmental data required for structural design of Wind Turbine Generating Systems is discussed in Section 5. Other environmental data and analysis is often necessary for wind resource assessment, energy production estimates and to satisfy project financing requirements, which are outside the scope of this document.

As illustrated in Figure 1, *Developers* play the central role in collecting the necessary site information and managing the activities required to successfully navigate the project approval process. *Developers*, together with wind turbine and component manufacturers, financiers, designers, consultants, construction contractors and certification agencies all play active roles in driving the industry. The goal of *Developers* is to find, develop and optimize economical competitive solutions to produce reliable wind energy for delivery onto the electric power grid and purchase by utilities or other power purchasers. Typically, the *Developer* uses a multidisciplinary design team, which functionally includes wind measurement, wind turbine selection, site layout, civil, geotechnical, environmental, structural, interconnection, electrical and safety engineers. During the initial stage of project development, several wind turbine types and models are technically evaluated based on input from wind turbine suppliers and the then known site conditions. In iterative and parallel fashion, the wind project design progresses as the wind regime, interconnection, environmental permitting, and turbine selection move forward in a converging manner to an economical, and ideally optimal, wind project design. When the final wind turbine model and layout is identified by the *Developer*, site-specific engineering designs for constructing the wind project is prepared by the *Engineer* of Record and could be verified by an Independent *Engineer* on behalf of investors or other stakeholders. Independent third party consultants serve to provide an independent view of the project and an independent review is typically required for project financing and possibly the *Developer's* internal approval board.

Guidance on Wind Turbine design, manufacturing, transportation and installation is provided by the International Electrotechnical Commission IEC 61400 series of Standards and Technical Specifications. Of interest to Authorities Having Jurisdiction, the following parts of the IEC 61400 Standard are identified which establish minimum design criteria for wind turbines.

- IEC 61400-1: Wind Turbines – Design requirements
- IEC 61400-3: Design requirements for offshore wind turbines
- IEC 61400-11: Acoustic Noise Measurement Techniques
- IEC 61400-12: Power Performance Measurements of Electricity Producing Wind Turbines

- IEC 61400-13: Measurement of Mechanical Loads
- IEC 61400-21: Measurement and Assessment of Power Quality Characteristics of Grid Connected Wind Turbines
- IEC 61400-22: Conformity Testing and Certification of Wind Turbines
- IEC 61400-23: Full-scale Structural Testing of Rotor Blades

Wind turbines are generally type certified or objectively evaluated according to the Standards above and/or according to rules or guidelines developed by Certification Agencies. Type certification of wind turbines are performed by a Certification Agency. Authorities Having Jurisdiction and *Developers* could choose to accept type certificates using Guidelines developed by a Certification Agency. If Guidelines by a Certification Agency are used, documentation will indicate that type certification of the wind turbine design meets or exceeds the requirement for structural integrity and reliability achieved by IEC 61400-1.

Type certified wind turbines can be used at projects as a means for stakeholders to gain comfort that a turbine design has met certain design criteria, either to IEC or Certification Agency standards. AHJs depend on *Developers* to demonstrate that certain aspects of local code requirements have been met and AHJs may not be satisfied by type certification. Such authorities often will request state Registered Professional *Engineer* certification that the design of the system, be it the wind turbine, the foundation, or the electrical system, meets specific aspects of the local code and certification to IEC or Certification Agency Guidelines are irrelevant in this regard (although the *Engineer* of Record for the local permit application may well depend on such certification in their due diligence to provide the relevant opinion). Further, *Developers* can select turbines based on type certification, but must still demonstrate compliance with local codes as well as prudent engineering practices (e.g. hurricane and seismic conditions) and they must ultimately comply, usually with full understanding of the design of the turbine. This process allows economic flexibility when developing a project so long as the structural integrity of the turbine, tower and foundation meet local codes and prudent engineering practice. The point is that type certification is a guide to the *Developer* and AHJs for understanding turbine suitability given site specific conditions, and that subsequent design and/or economic adjustments must be accounted for to meet local code requirements.

Further, the reader should not confuse the focus and interests of AHJs with those of the financing parties. AHJs depend on the opinions of Registered Professional *Engineers* (the *Engineer* of Record) that are obligated to comply with state engineering regulations and local codes whereas finance parties are able to rely upon independent engineers for expert opinions but who are not necessarily Registered Professional *Engineers*.

Generally speaking, the Manufacturer of the selected wind turbine often secures type certificates for the Wind Turbine Generator System. The *Developer* or *Engineers* on the project team (including the *Engineer* of Record) are responsible for ascertaining the suitability of the turbines for a site-specific wind conditions and related structural loading. Turbine and site-specific suitability calculations are generally performed by the Wind *Turbine Manufacturer* for the *Developer* and these calculations can be used by the *Engineer* of Record for developing their application to the AHJ. An Independent *Engineer* may also verify the findings for the Financier. The EOR's design of the overall Wind Turbine Generating System (and it's design loading capacity) must meet or exceed loading conditions expected at the project site and all local building code requirements including foundation, electrical, structural, environmental and safety requirements for the site and as defined by an Authority Having Jurisdiction or Local Building Official. Specific recommendations for foundation, tower, environmental and safety requirements are presented in Sections 5 through 10 of this *Recommended Practice*.

The *Engineer* of Record is responsible for completeness of the site-specific geotechnical evaluation, compliance with zoning, land-use, set-backs, height restrictions, preparing the foundation and tower design, while AHJs are responsible for review and approval of the



submittal. A suggested compliance check-list of minimum requirements for these two parties is provided in Appendix A of this *Recommended Practice*. Upon satisfactory documentation, demonstration of local code compliance, and permit evaluation by the Authority Having Jurisdiction, a Construction Permit is granted. At this stage, wind turbines are generally ordered and site preparation may begin. Construction supervision and inspections of foundations, roads, buildings, etc. are to be documented by the *Engineer* of Record and should follow requirements provided in Section 9 of this document and the Turbine Manufacturer's installation manual.

Delivery, staging, assembly, installation and erection of the wind turbine, tower, nacelle, hub and blades are the responsibility of the *Turbine Manufacturer* or Construction Contractor, depending upon their contractual requirements. Assembly is to follow manufacturer specifications and instructions inclusive of mechanical completion inspections and verifications by the *Turbine Manufacturer*.

*Commissioning* of a wind project is typically in coordination with contractors, wind *turbine manufacturer*, municipalities, and transmission system operators. Upon completion of the commissioning tests, proper training of personnel for operations and maintenance of wind turbines and reports submitted to Authorities Having Jurisdiction a Use Permit is granted to cover a period equivalent to the wind turbine design lifetime. Inspections, monitoring and maintenance of wind farms are documented in the operations and maintenance manual and other proprietary records. Guidance for inspection and structural health monitoring of wind turbines is given in Section 10 of this *Recommended Practice* document.

## **4.2 Coordination of International and U.S. Standards**

Since the commercial wind turbine industry evolved in Europe and because wind *turbine manufacturers* are part of a global market, a mix of international, European and U.S. standards in project construction documents is almost unavoidable. Recognizing that the Authority Having Jurisdiction has final authority on the interpretation of local building code requirements and that the Certification Agencies may have their own requirements, the following sections provide recommendations to assist both engineers and AHJs to reconcile international wind turbine structural design requirements with U.S. local building code requirements.

### **4.2.1 Conflicting Standards**

The recommendations in this document should not be construed to place administrative responsibility for conflict resolution on the *Engineer* of Record. It is recommended that the *Developer* in consultation with their *Engineer* of Record communicates with the *turbine manufacturer* and the appropriate AHJ to consider strategies to accept, reject, or modify conflicting standards. Additional specific information about conflicting standards is provided in remaining sections of this document.

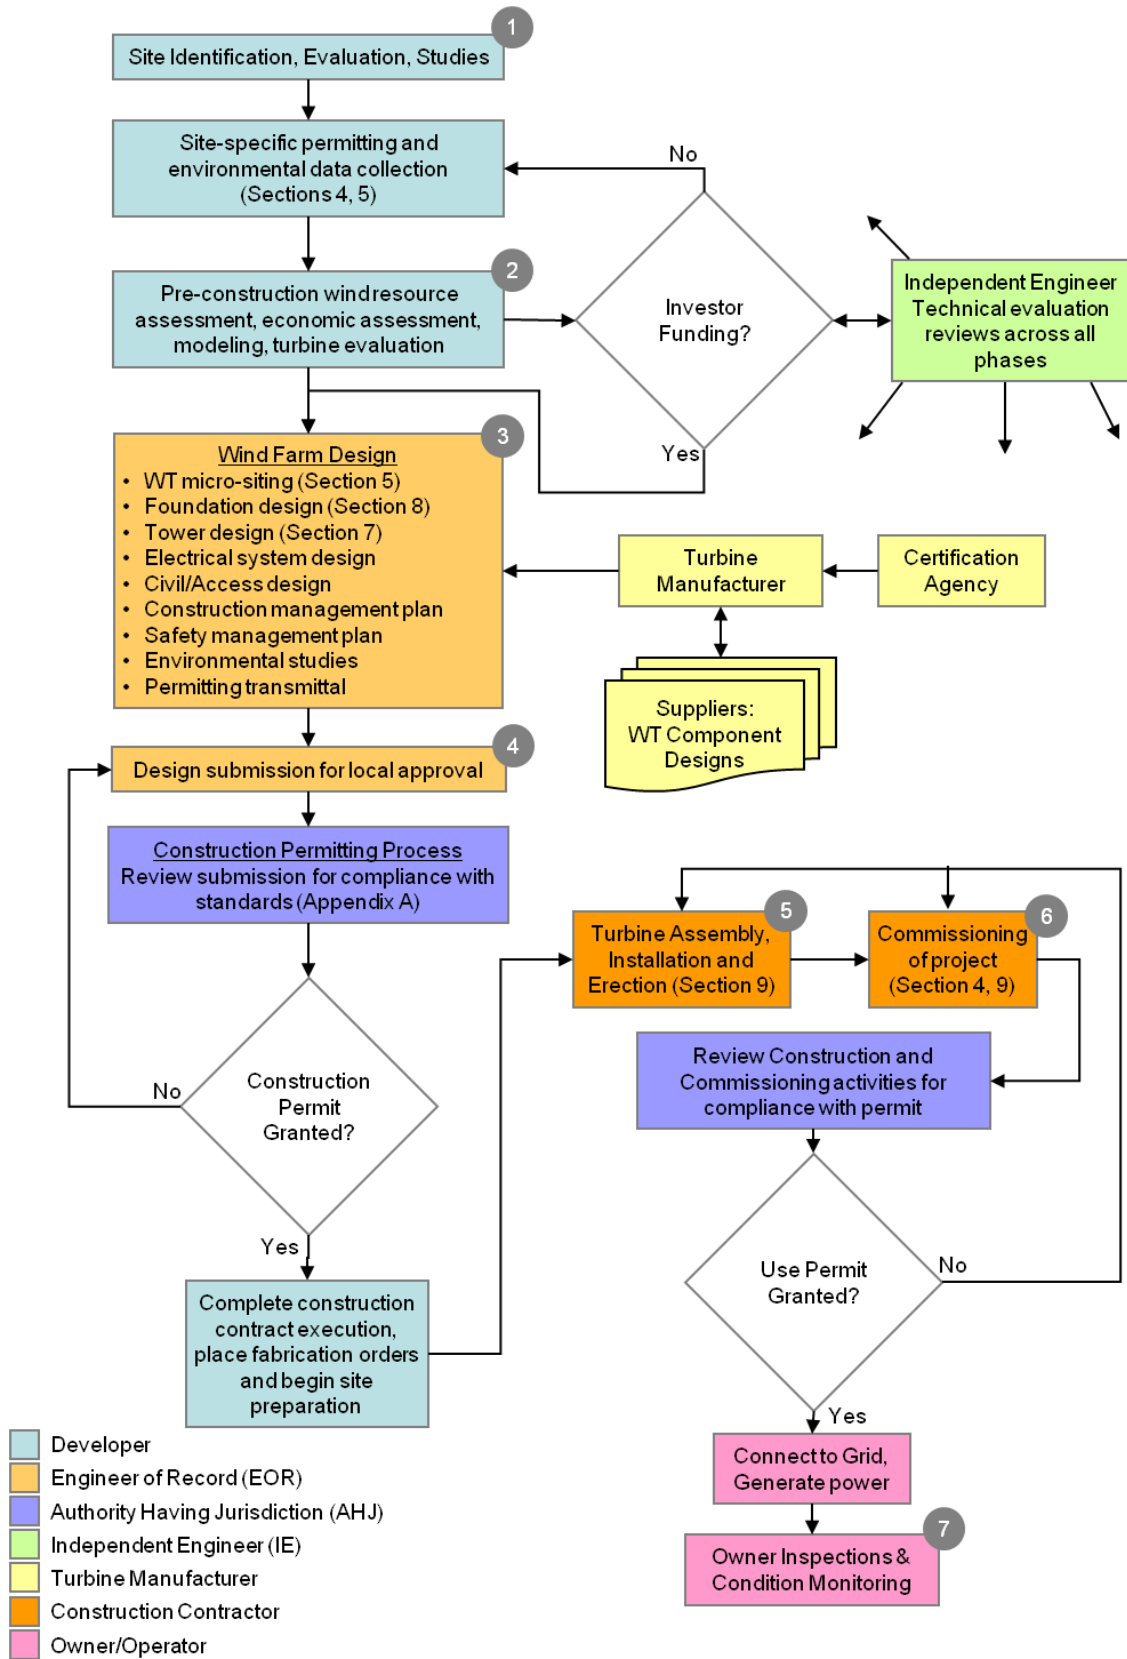


Figure 4-1: General wind farm project development

#### 4.2.2 Design Standards

Where the local building code enforced by the Authority Having Jurisdiction has regulatory authority for *WTGS support* structure design, recommendations in this document should not be construed to undermine or avoid code compliance, nor should this document be viewed to promote lesser standards than those of the local building code. However, it is recognized that IEC standards and Certification Agency Guidelines are specialized for the purpose of WTGS support structure design. It is therefore recommended that IEC standards and Certification Agency rules serve as the primary design basis for wind WTGS structural design. The *Developer* and their *Engineer* of Record may then provide documentation to reconcile and show compliance with local building code provisions to the satisfaction of the Authority Having Jurisdiction.

Where the local building code is to serve as the primary design basis for *WTGS support* structures, it is recommended that the *Developer* and their *Engineer* of Record, in close coordination with the *turbine manufacturer*, ascertain whether IEC-type design load cases (DLC) would govern over the extreme wind loads, seismic load combinations, and fatigue loads developed from the local building code alone. The *Engineer* of Record is cautioned that the local building code's lack of specific provisions for WTGS support structures design may make it insufficient to serve alone as an appropriate design basis.

It should be recognized that from an engineering point of view (apart from regulatory concerns); the international standards utilized in the wind industry are accepted as best practice in many portions of the industrialized world, including the U.S. Thus, an understanding of these international standards are important for the *Engineer's* ability to properly design the support structure for the WTGS and the AHJs ability to rely on the standards as part of the permit application review process. The *Developer* in consultation with their *Engineer* of Record may consider the use of international design standards in lieu of U.S. standards under the "alternative acceptance procedures" found in most standards after due consideration and the judicious use of engineering judgment and best practices. However, it should be recognized that compliance with local codes must still be demonstrated to the Authority Having Jurisdiction who has final authority to accept and rely upon alternative standards and they may require additional substantiation.

#### 4.2.3 Quality Assurance/Quality Control

Quality Assurance for the design and permitting of wind turbine structures is achieved by the following tasks:

- Review of wind turbine certification to ensure it is current, complete and reflects the turbine to be deployed;
- Site-specific Design Evaluation to ensure suitability of tower and foundation for site soil, seismic, climatic and all other relevant conditions.
- Project construction supervision and inspections
- Commissioning tests, operations and maintenance training
- Monitoring and Maintenance records

The following recommendations should not govern over specific provisions addressing quality assurance/quality control (QA/QC) elsewhere in this document. Conflict between U.S. and international standards are most likely to occur between the *Engineer's* design and construction documents, the *turbine manufacturer's* specifications, and the fabricators (or contractor's) internal standards. While this *Recommended Practice* makes no attempt to assign coordination responsibilities, it is recommended that coordination and conflict resolution strategies be addressed among the project team before actual conflict arises. It is therefore recommended that provisions be made for the following conditions:

- Design drawings should incorporate QA/QC requirements explicitly or by reference.

- Attempt at coordination of QA/QC (e.g., testing and inspection requirements) among the *Engineer's* construction documents, the fabricator's QA/QC specifications, and the *turbine manufacturer's* specifications.
- Creation of a baseline or default requirement that (where applicable) the local building code's inspection and testing requirements should serve as a minimum requirement. In the event of conflict with International standards, conflict may be resolved by deferring to the more stringent standard.
- In the event of disagreement on the interpretation or implementation of any aspect of the QA/QC requirements, an independent opinion should be obtained at the expense of the party promoting the lesser requirement. The independent opinion should be from a mutually agreed third party professional with expertise in the testing or inspecting methods being disputed. In some cases, the *Engineer's* opinion may prevail, but it is recognized that in some cases,
- QA/QC issues require detailed and specialized knowledge outside the scope of typical engineering design, such as: means and methods of fabrication; production welding processes; familiarity with the use of specific inspection equipment; etc. In these cases, the *Engineer* may request that a specialized welding engineer or equipment technician be consulted for an informed opinion.
- Independent *Engineer* may review construction quality assurance and quality control plan to assess if controls are in place to ensure compliance with design assumptions and construction specification.
- As recommended in IEC 61400-1 the quality system should comply with the requirements of ISO 9001.

### 4.3 Component Classifications

The integrated wind turbine system is classified according to the design parameters (i.e. reference wind speed, turbulence, temperature, humidity, etc.) in its design basis. These parameters are tabulated in IEC 61400-1, and are also shown in Table 5-1 of this *Recommended Practice*. This could be considered as a standard safety classification of the wind turbine system irrespective of actual local conditions on the site. Furthermore, wind turbine components may have safety levels that depend on the consequences of failure to the global system. IEC 61400-1 tabulates values for consequence depending on the component in consideration. In addition, safety factors for loading depending on its type; and material safety factors depending on the failure mechanism are presented in Section 5. These safety factors in IEC 61400-1 can, to some degree, be compared to the importance, load and strength reduction factors, respectively, in the U.S. standards. The values for these factors according to IEC 61400-1 are given in Section 5. In this section it is relevant to distinguish between the three given component consequence groups.

Component Class 1 (CC1) – load-bearing (structural) component that its failure would not result in major failure of the wind turbine (fail-safe structural components).

Component Class 2 (CC2) – load-bearing (structural) component that its failure would result in major failure of the wind turbine (non fail-safe structural components).

Component Class 3 (CC3) – mechanical component that is connected to the main structure and is used as part of the turbine protection system (non fail-safe mechanical components).

### 4.4 Occupancy Category

Where it is necessary to determine the Occupancy Category as defined in ASCE 7, WTGS may be classified as Occupancy Category II structures, resulting in normal design importance factors. The "power generating stations" item under Occupancy Category III, resulting in higher design importance factors, typically applies to conventional power plants capable of generating continuous power. In contrast, wind farms cannot generate continuous power nor should a WTGS be relied upon for continuous or on-demand power for essential or emergency response facilities and other Occupancy Category III or IV facilities. In general, higher importance factors

would result in design conservatism. Proximity or association of the WTGS installation with other Occupancy Category III or IV structures may require that the WTGS installation match the higher classification by default. Where it is proposed to use a lower Occupancy Category classification than that of the associated facility or project, it is recommended that the *Engineer* seek approval from Authority Having Jurisdiction to do so.

## 5 External conditions and loads

### 5.1 General

As stated in IEC 61400-1, the appropriate level of safety and reliability, environmental, electrical and soil parameters should be taken into account and explicitly stated in the design documentation.

The following sections present a general picture of the external conditions considered in the design of a wind turbine according to IEC 61400-1 and provide design checks for compliance with specific external conditions covered in ASCE 7-05 for the U.S. The primary external condition affecting structural integrity of wind turbines are the wind conditions and these are separated in two types: (1) normal conditions and (2) extreme conditions. Normal conditions generally concern recurrent structural loading during normal operation of a wind turbine between *cut-in* and *cut-out* wind speeds, and extreme conditions represent rare external design conditions defined as having a 1-year and 50-year recurrence periods.

The wind conditions defined in this section are generally concerned with a mean 10-minute flow combined, in many cases, with either a varying deterministic gust profile or with turbulence. Specific turbulence characteristics for longitudinal, lateral and vertical directions, turbulence scale parameter, power spectral densities and wind field coherence are given in IEC 61400-1. These turbulence characteristics are commonly considered in the design of wind turbines. When siting a wind turbine in a given location, turbulence conditions on site should be verified by either complying with the terrain/topographic exposure characteristics of the site or with site-specific data as may be required for complex terrain.

### 5.2 Wind turbine classes

Wind turbines are designed and generally certified according to turbine classes shown in Table 5-1. Turbines are basically categorized according to an extreme reference wind speed and turbulence level. Reference wind speeds averaged over 10-minutes at wind turbine hub-height are used as the basis to differentiate design classes with respect to conditions that need to be survived. When other external conditions such as temperature range, humidity, air density, wind shear, and turbulence conditions, etc. are within prescribed values shown in IEC 61400-1, then sites can be classified according to standard design Classes I, II and III. These are intended to cover most locations where turbines are deployed. However, these do not give precise representation of any specific site; do not cover offshore conditions, thunderstorm events, low level jets, tropical storms such as hurricanes or seismic conditions. Site specific conditions should be verified as discussed later in this section. In addition to the standard design classes a manufacturer may modify the design envelope and the resulting wind turbine will be classified as Special (S) to cover those specific conditions.

**Table 5-1: Basic parameters for wind turbine classes**

Wind turbine class	I	II	III	S
$V_{ref}$ (m/s)	50	42.5	37.5	Values specified by the designer
$V_{e50(IEC)}$ (m/s)	70	59.5	52.5	
$V_{e50(IEC)}$ (mph)	156.6	133.1	117.4	
$V_{e50(ASCE7)}$ (mph)	<b>See Section 5.3.4, 5.4.8 and 5.4.9 for conversion from ASCE basic wind speed</b>			
A $I_{ref}$ (-)	0.16 (see Section 5.3.6)			
B $I_{ref}$ (-)	0.14 (see Section 5.3.6)			
C $I_{ref}$ (-)	0.12 (see Section 5.3.6)			

In Table 5-1, parameter values refer to hub height except for  $V_{e50(ASCE7)}$  which is meant as a conversion from the common basic wind speed in ASCE 7 and as defined below.

$V_{ref}$	is the reference wind speed averaged over 10 minutes at hub height.
$V_{e50(IEC)}$	extreme 3-second gust wind speed at hub-height with Return Period = 50 years.
$V_{e50(ASCE7)}$	extreme 3-second gust wind speed (ASCE 7 Basic Wind Speed) extrapolated to hub height with Return Period = 50 years.
A	category for higher turbulence (correspond to Exposure B in ASCE 7)
B	category for medium turbulence (correspond to Exposure C in ASCE 7)
C	category for lower turbulence (correspond to Exposure D in ASCE 7)
$I_{ref}$	is the expected value of the turbulence intensity at 15 m/s.

### 5.3 External conditions required for assessment

In addition to the basic parameter values of Table 5-1, standard wind turbine classes are designed for normal wind conditions, extreme wind conditions and other environmental conditions including temperature, air density, etc. The standard wind turbines classes do not account for detailed characteristics of thunderstorm events, tropical storms or earthquakes. However, understanding that these events are common in many jurisdictions in the U.S., basic recommendations to consider velocity profile and potential yaw misalignment in thunderstorms, recommendations for hurricane-prone conditions and earthquakes are provided in this *Recommended Practice*.

ASCE 7 is based on a neutrally stable atmospheric boundary layer model for strong winds. It may also be applied to hurricane winds. Its primary purpose is to provide wind load recommendations for the design of conventional structures and buildings. However, characterization of non-neutral, thermally driven winds is not addressed in ASCE 7. IEC provides detailed information about normal and extreme wind conditions as presented in the following sections. The extreme wind speed model (EWM) of IEC can be compared to ASCE 7 provisions.

The following models are adopted from IEC 61400-1 with the observations below:

#### 5.3.1 Normal Wind speed probability distribution

The probability density function of the reference 10-minute mean wind speed is fitted by a Weibull distribution at most sites. This is important to characterize wind speed frequency and fatigue load spectrum produced by loads between *cut-in* and *cut-out* wind speeds.

#### 5.3.2 Normal wind profile model (NWP)

The 10-minute mean wind speed variation with height is represented by a power law with respect to the hub height and with exponent of 0.2 for the standard wind turbine classes I, II and III. The shear of IEC model is more conservative (i.e. the change of wind speed between lower and upper heights is greater) than that provided by ASCE 7-05.

Therefore Equation 5-1 from IEC is recommended as a conservative normal (mean) wind speed velocity profile for open terrain.

$$V(z) = \left(\frac{z}{z_{hub}}\right)^{\alpha} \cdot V_{hub} \quad (\text{Eq 5-1})$$

$\alpha = 0.2$  for normal wind conditions

### 5.3.3 Normal turbulence model (NTM)

A linear expression is given for wind speed standard deviation as a function of wind speed at hub height in the IEC standard. When the standard deviation is divided by mean wind speed at hub height to obtain turbulence intensity as function of wind speed, an exponential-like function shows the decreasing turbulence intensity with increasing wind speed. ASCE 7 provides an expression for turbulence intensity but this is not a function of average wind speed which is needed for the assessment of fatigue design load cases in section 5.4.3.1. Therefore, the NTM in IEC is found to be more suitable for support structure design than that provided in ASCE 7.

### 5.3.4 Extreme wind speed model (EWM)

#### 5.3.4.1 Velocity Profile

The conversion from 10-minute mean to 3-second gust in IEC 61400-1 is nearly identical to ASCE 7 (i.e. Durst's averaging time correction of  $1.52/1.1 \approx 1.4$  based on ASCE 7 commentary).

For extreme wind speeds in open terrain Equation 5-1 with power law exponent,

$\alpha = 0.11$  for extreme gust profiles should be used.

Appendix C shows that ASCE 7 gust velocity profile and IEC 61400 extreme wind speed profile match well for open terrain with little or no obstructions (i.e. Exposure C according to ASCE 7-05). Terrains with Exposure D (lower turbulence) should use velocity profile from ASCE 7 modified for exposure as given by Eq C5-3, illustrated in Figure C5-1.

The exponent in IEC 61400-1 is 0.11 and in ASCE 7 is 0.11 (i.e.  $1/9.5$  for open terrain). Therefore the extreme gust wind speed profile model in IEC 61400-1 and ASCE 7 are identical for open terrain.

In this provision IEC 61400-1 requires the consideration of  $\pm 15$  degree of yaw misalignment to allow for short-term deviations from the 10-minute average wind direction. This provision of potential yaw misalignment should be verified for hurricane and extreme thunderstorm regions by a wind engineer in consultation with the manufacturer. Large wind turbines are parked/idle beyond *cut-out* wind speeds and the yaw mechanism generally continues to adjust the rotor axis for mean wind direction every 10-minutes under normal turbine conditions. In absence of site-specific advice, for the turbine support structure a yaw misalignment of  $\pm 15$ ,  $\pm 45$ ,  $\pm 90$  and  $180$  degrees (multi-directional) during parked/idling conditions is a recommended evaluation to consider the possibility that a strong thunderstorm or hurricane could change directions faster than the yaw drive can respond (i.e. normal turbine conditions) or if the yaw drive is not operating due to lack of power (i.e. abnormal turbine conditions). See Design Load Case (DLC) 6.1 and 6.2 in Table 5-2. DLC 6.1 is a normal turbine condition where power is supplied and DLC 6.2 corresponds to abnormal turbine condition for loss of power network.

Thunderstorm events have a different wind speed profile than extreme synoptic or hurricane events. Wind speeds in thunderstorms are produced by a number of mechanical and thermal mechanisms and are generally defined by a thunderstorm outflow, gust front or a nearby downdraft that produce a nose-like velocity profile (i.e. not indefinitely increasing wind speed with height). ISO 4354 [2009] suggest a specific thunderstorm profile for informative purposes in their Appendix.

Wind speed profiles for tropical cyclones (hurricanes) have produced a wide scatter of results in research. The basic agreement found in ISO 4354 with regards to extreme wind velocity profiles is that the power law (or logarithmic law) profiles described in meteorological literature applies near the ground and up to 500 meters.



#### 5.3.4.2 Turbulence intensity for extreme conditions

Equation 6-5 of ASCE 7-05 shows how turbulence intensity can be calculated as a function of height. ASCE 7 describes the turbulence intensity for rough/urban exposure (ASCE 7 Exposure B = IEC 61400-1 exposure A), Open Terrain with scattered obstructions (ASCE 7 Exposure C = IEC 61400-1 exposure B) and very flat terrain or facing shallow water bodies (ASCE 7 Exposure D = IEC 61400-1 exposure C). Turbulence intensity profiles in IEC 61400-1 versus ASCE 7 are shown in Appendix C. For very flat terrain with no obstructions or facing shallow water bodies the turbulence characteristics are the same in IEC 61400-1 and ASCE 7. For open terrain/open country (ASCE 7-05 Exposure C) with few scattered obstructions and rougher exposures it is recommended to use ASCE 7 velocity profile criteria for the different terrain exposures (See Appendix C) and/or site-specific verifications undertaken to account for the differences in turbulence, especially for the rougher terrain as IEC 61400-1 may give less conservative designs.

#### 5.3.5 Extreme operating gust (EOG)

When analyzing the wind turbine in the time domain for specific manoeuvres it is necessary to consider the extreme gust as a function of time. The extreme operating gust is considered in fault conditions during power production, start-up and shut-down. Section 6.3.2.2 of the IEC 61400-1 (2005) document presents a trigonometric expression for wind speed at hub height as a function of time. In the absence of well-documented extreme operating gusts for hurricanes and thunderstorms at hub-height, IEC 61400-1 extreme operating gust should remain as the standard baseline evaluation.

#### 5.3.6 Extreme turbulence model (ETM)

During the operational state of a wind turbine (between *cut-in* and *cut-out* wind speeds), in addition to normal turbulence as a function of average wind speed (Section 5.3.3), the extreme wind turbulence needs to be considered. Section 6.3.2.2 of the IEC 61400-1 (2005) presents an expression for extreme turbulence for use within *cut-in* and *cut-out* speeds of the turbine. ASCE 7-05 does not have a comparable provision.

#### 5.3.7 Extreme direction change (EDC)

Large direction changes are not uncommon, particularly at low wind speeds (turbine start-up). IEC 61400-1 specifies in Section 6.3.2.4 a transient direction change in such instances with duration of 6 seconds. Furthermore, IEC 61400-1 specifies maximum extreme direction changes that decrease with increasing wind speed. It specifies a maximum EDC of 30 degrees in 6 seconds for extreme wind speeds which according to IEC 61400-1 definitions, might include thunderstorms during operational wind turbine state (between *cut-in* and *cut-out* wind speeds). Unless indicated otherwise by the Authority Having Jurisdiction, it is recommended to follow IEC 61400-1 EDC.

#### 5.3.8 Extreme coherent gust with direction change (ECD)

During power production without faulty conditions, a time domain analysis is necessary to verify structural integrity to identify dynamic response under extreme gusts across the rotor area. For this reason, and similar to the extreme operating gust and extreme direction change, a transient wind speed and direction change function is specified in IEC 61400-1 for these input conditions. ASCE 7-05 does not provide applicable provisions for this wind characterization in normal (mean) wind conditions.

#### 5.3.9 Extreme wind shear (EWS)

During power production (between *cut-in* and *cut-out* wind speeds), the normal wind profile only accounts for a uniform positive shear in the power law expression (monotonic increase in wind speed with height). During power production many other meteorological conditions arise where the atmospheric shear changes dramatically in time, vertically and horizontally. IEC 61400-1 provides an expression to account for these vertical and horizontal shears which impose large

moments about the rotor axis in a transient fashion. The extreme wind shear presented in IEC 61400-1 accounts for both positive and negative shear for normal wind conditions.

### 5.3.10 Other environmental conditions

In addition to wind conditions many other variables can impact the design of a wind turbine. The following list of parameters from site conditions should be checked against the standard turbine class values in IEC 61400-1 or in the design documentation. There are normal and survival temperature ranges to be considered. For example, normal temperatures of relevance to structural design will have minimum range of -20C to +50C.

- Temperature
- Humidity
- Air density
- Solar radiation
- Rain, hail, snow and ice
- Chemically active substances
- Mechanically active substances
- Salinity
- Lightning

## 5.4 Loads and load calculations

### 5.4.1 General

In general, loading should be in accordance with IEC 61400-1 [IEC, 2005] or Certification Agency Guidelines. Under no circumstance should these loadings be allowed to produce a design safety level that would be less than that required by the *local building code*. In the absence of a *local building code*, the IBC and ASCE 7 standard may be used to represent *local building code* requirements. In addition to *local building code* prescribed loads and load combinations this document recommends “best practice” load combinations that consider the combination of wind and seismic loading that is unique to WTGS support structures.

In practice, wind *turbine manufacturers* may provide a *Loads Document* created in accordance with IEC 61400-1 Standards or *Certification Agency Guidelines*. The loads therein are typically generated using highly specialized (and often proprietary) software capable of dynamic load simulation. To show compliance with the *local building code*, it is recommended that the tower *Engineer* compare the *Loads Document* extreme wind design load to show that it meets or exceeds the *local building code’s* extreme wind load. The *Engineer* should also evaluate the earthquake plus operational load combinations appropriate for the project site.

The Engineer should be aware of and consider that many turbine loads analysts throughout the wind industry may still use a widely followed analysis modelling convention wherein only wind loads on the turbine are considered while wind loads along the tower support structure are ignored. In general, while the contribution of wind loading along the tower support structure may be relatively small compared to the turbine loading, the ever-increasing use of taller and larger support structures may result in loads that should not be neglected in design.

Section 5.4.6 describes how the wind loads along the tower mast should be considered to satisfy AHJs.

Section 5.4.8 and 5.4.9 describe how wind turbines designed according IEC 61400-1 wind speeds can be shown to meet site-specific wind conditions.

### 5.4.2 Wind turbine modelling and loading considerations

Companies involved in the analysis of wind turbine modelling; whether as Consultants, Manufacturers or Designers, should consider the entire generation system which include a variety of mechanisms that work in synchronization. Among the mechanisms that need to be considered are:

- Control functions
- Protection functions
- Braking system
- Errors of fitting
- Hydraulic or pneumatic systems
- Main gearbox
- Yaw system
- Pitch system
- Protection function mechanical brakes


The design process should be able to handle loading from a number of sources as applicable to the site-specific conditions, and allow for the different load safety factors involved in the process. Large wind turbine loads should be defined by dynamic aero-servo-elastic codes considering the following:

- Gravitational and inertial loads
- Aerodynamic loads
- Actuation loads
- Other loads (wake effect, impact, ice loads)

The integrated wind turbine loading characterization is typically done as part of a Type Certification process as described in Section 4 and a Loads Document produced as explained in Section 5.4.1.

#### 5.4.2.1 Local Coordinate System

The following figure shows the most frequently used coordinate system used to define forces and moments in the tower and the foundation of the structure. Mainly, the z-direction is vertical upward along wind turbine tower; the x-direction is pointing downwind parallel to wind turbine drive train axis (i.e. turbine main shaft axis); and the y-direction is perpendicular to drive train axis.

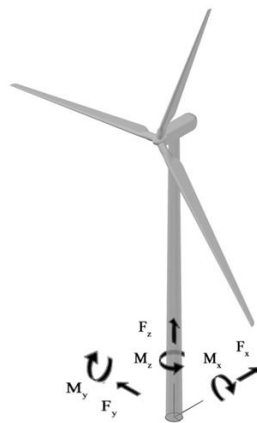

**Figure 5-1: Wind tower and foundation coordinate system for forces and moments**

### 5.4.3 Design situations and loads cases

#### 5.4.3.1 General

When designing a wind turbine a minimum number of design situations need to be considered to cover worst case loading conditions as analysed and used for the design of its components. These loading conditions can occur during start-up, power production, shut down, still or idling, transport, assembly, maintenance and repair phases of construction and operation. These conditions must also consider occurrence of faults (control or protection system failure or loss of electrical network) during operation and still or idling conditions. The minimum number of design situations and load cases are covered in thorough detail in IEC 61400-1 Section 7.4. These design load cases from IEC 61400-1 are shown in Table 5-2 for reference purposes. Other design load cases should be considered, if relevant to the structural integrity of the specific wind turbine design. For seismic or hurricane-prone regions refer to Sections 5.4.4, 5.3.4 and 5.4.8 of this *Recommended Practice*.

**Table 5-2: Design load cases (IEC 61400-1, 2005 with SI Units)**

Design Situation	DLC	Wind conditions	Other conditions	Type of analysis	Partial Safety Factor
1) Power production	1.1	NTM $V_{in} < V_{hub} < V_{out}$	For extrapolation of extreme events	U	N
	1.2	NTM $V_{in} < V_{hub} < V_{out}$		F	*
	1.3	ETM $V_{in} < V_{hub} < V_{out}$		U	N
	1.4	ECD $V_{hub} = V_r \pm 2.0\text{m/s}$ and $= V_r$		U	N
	1.5	EWS $V_{in} < V_{hub} < V_{out}$		U	N
2) Power production plus occurrence of fault	2.1	NTM $V_{in} < V_{hub} < V_{out}$	Control system fault or loss of electrical network	U	N
	2.2	NTM $V_{in} < V_{hub} < V_{out}$	Protection system or preceding internal electrical fault	U	A
	2.3	EOG $V_{hub} = V_r \pm 2.0\text{m/s}$ and $= V_{out}$	External or internal electrical fault including loss of electrical network	U	A
	2.4	NTM $V_{in} < V_{hub} < V_{out}$	Control, protection, or electrical system faults including loss of electrical network	F	*
3) Start up	3.1	NWP $V_{in} < V_{hub} < V_{out}$		F	*
	3.2	EOG $V_{hub} = V_{in}$ $V_{hub} = V_r \pm 2.0\text{m/s}$ and $= V_{out}$		U	N
	3.3	EDC $V_{hub} = V_{in}$ $V_{hub} = V_r \pm 2.0\text{m/s}$ and $= V_{out}$		U	N
4) Normal shut down	4.1	NWP $V_{in} < V_{hub} < V_{out}$		F	*
	4.2	EOG $V_{hub} = V_r \pm 2.0\text{m/s}$ and $= V_{out}$		U	N
5) Emergency shut down	5.1	NTM $V_{hub} = V_r \pm 2.0\text{m/s}$ and $= V_{out}$		U	N

6) Parked (standing still or idling)	6.1	EWM	50-year recurrence period		U	N
	6.2	EWM	50-year recurrence period	Loss of electrical network connection	U	A
	6.3	EWM	1-year recurrence period	Extreme yaw misalignment	U	N
	6.4	NTM	$V_{hub} < 0.7 V_{ref}$		F	*
7) Parked and fault conditions	7.1	EWM	1-year recurrence period		U	A
8) Transport, assembly, maintenance and repair	8.1	NTM	$V_{maint}$ to be stated by the manufacturer		U	T
	8.2	EWM	1-year recurrence period		U	A

Abbreviations used in Table 5-2:

DLC	Design load case
ECD	Extreme coherent gust with direction change
EDC	Extreme direction change
EOG	Extreme operating gust
EWM	Extreme wind speed
EWS	Extreme wind shear
NTM	Normal turbulence model
ETM	Extreme turbulence model
NWP	Normal wind profile model
$V_r \pm 2m/s$	Sensitivity to all wind speeds in the range should be analyzed
F	Fatigue
U	Ultimate strength
N	Normal
A	Abnormal
T	Transport and erection
*	Partial safety for fatigue

**5.4.3.2 Safety factors**

Safety factors for the design of wind turbines are defined somewhat similar to U.S. Standards. In the U.S. Standards, there are three safety factors: facility importance factor, material strength reduction factor and load factor. In the design of wind turbines there are three safety factors: component consequence factor, material safety factor and loading safety factor.

As discussed in Section 4.4, the category of wind power facilities can be considered such that an Importance Factor of 1.0 applies for their overall design, however, depending on the consequence of failure of a given component a consequence factor will apply. In most cases applicable of this *Recommended Practice* a Consequence Class 2 applies as failure of the support structure may lead to the failure of a major part of the wind turbine. In these cases, except for fatigue design the safety level due to consequence of failure has a factor of 1.0 which is the same as the Importance Factor of 1.0.

Material partial safety factors or its reciprocal, strength reduction factors, should be carefully evaluated in each case. For the design of steel towers it is thought that material safety factors are comparable in IEC 61400-1 and those in AISC, but for the design of foundations IEC 61400-1 is thought to be less conservative in some cases. As more research becomes available, more specific recommendation will be given in future revisions of this *Recommended Practice* or in the development of a Standard. In the mean time, Section 8 documents the current best practice in foundation design.

Loading safety factors in IEC 61400-1 are in general more comprehensive than local building codes as it includes many wind turbine load cases. However, it should be noted that for the design of facilities in the U.S. a loading safety factor on the extreme 50-year wind loads (DLC 6.1) of 1.6 reduced by the wind directionality factor applies. For DLC 6.1 in large wind turbine structures, a wind directionality factor of 0.95 is recommended for this calculation. It is not required to apply the safety factor of 1.6 for the load simulation per IEC 61400-1 but it should be used for loads per ASCE 7-05.

#### 5.4.3.3 Limit state analysis

Ultimate limit state analyses make use of partial safety factors to account for the uncertainties and variability in loads and materials, the uncertainties in the analysis methods and the importance of structural components with respect to the consequences of failure. These partial safety factors relate characteristic loads and material strengths to their design values. The partial safety factors that ensure safe design values are defined in the following equations:

$$F_d = \gamma_f F_k \quad (\text{Eq 5-2})$$

where

$F_d$  is the design value for the aggregated internal load or load response  
 $\gamma_f$  is the partial safety factor for loads and  
 $F_k$  is the characteristic value for the load.

$$f_d = \frac{1}{\gamma_m} f_k \quad (\text{Eq 5-3})$$

where

$f_d$  is the design values for materials  
 $\gamma_m$  is the partial safety factor for materials; and  
 $f_k$  is the characteristic value of material properties.

The partial safety factors for loads take account of possible unfavorable deviations of the loads from their characteristic values and uncertainties in the loading model. The partial safety factors for materials used in this *Recommended Practice* take account of possible unfavorable deviations of the strength of materials relative to their characteristic value, inaccurate assessment of the resistance of sections or load carrying capacity of parts of the structure, uncertainties in geometric characteristics, conversion factors, and the relation between the material properties in the structure and those measured by tests on control specimens.

The general limit state condition that relates partial safety factors with loads or load cases, including those in Table 5-2, and material strength properties along with the consequences of failure is the following:

$$\gamma_f F_k \leq \frac{1}{\gamma_m \gamma_n} f_k \tag{Eq 5-4}$$

where  $\gamma_n$  is the partial safety factor for the consequences of failure. This limit state equation is applicable to different analysis types, including ultimate strength, fatigue, stability, and critical deflections. A summary of the partial safety factors and their associated analysis types is given in

Table 5-3.

**Table 5-3: Analysis types and partial safety factors for limit state load and resistance verifications**

Analysis Type	$\gamma_f$	$\gamma_m^a$	$\gamma_n$
Ultimate Strength Analysis	Table 5-4	$\geq 1.1^b$	CC1=0.9 CC2=1.0 CC3=1.3
		1.2 <sup>c</sup> for global buckling of curved shells such as tubular towers	
		1.3 for rupture from exceeding tensile or compression strength	
Fatigue Analysis	1.0	$\geq 0.9$ for welded and structural steel provided the SN curve is based on 97.7% survival probability with periodic inspection to detect critical crack development	CC1=1.0 CC2=1.15 CC3=1.3
		$\geq 1.1$ for welded and structural steel provided the SN curve is based on 97.7% survival probability	
		$\geq 1.5$ provided that the SN curve is based on 50% survival probability and coefficient of variation < 15%	
		$\geq 1.7$ provided that the SN curve is based on 50% survival probability and coefficient of variation > 15%	
Stability Analysis	Table 5-4	$\geq 1.1^b$	CC1=1.0 CC2=1.0 CC3=1.3
		1.2 <sup>c</sup> for global buckling or curved shells such as tubular towers	
		1.3 for rupture from exceeding tensile or compression strength	
Critical Deflection Analysis	Table 5-4	1.1 except when the elastic properties have been determined by full scale tests in which case it may be reduced to 1.0	CC1=1.0 CC2=1.0 CC3=1.3

<sup>a</sup> Partial safety factors for materials where recognized design codes are available should be combined and should not be less than those specified in

Table 5-3 as given by IEC 61400-1 for the respective analysis type unless otherwise documented to have the same safety level.

<sup>b</sup> Applies to characteristic material properties of 95 % survival probability with 95 % confidence limit. This value applies to components with ductile behavior and system redundancy.

<sup>c</sup> Safety factor of 1.2 may be relaxed to 1.1 when used in combination with DIN 18800-Part 4 and Eurocode 3-Part 1-6 for buckling capacity calculations or when proven to achieve the same safety level of IEC 61400-1.

**Table 5-4: Partial safety factors for loads  $\gamma_f$** 

Unfavorable loads			Favorable loads
Type of design situation (See Table 5-2)			All design situations
Normal (N)	Abnormal (A)	Transport and Erection (T)	All design situations
1.35 <sup>a,b</sup>	1.1	1.5	0.9

<sup>a</sup> A load factor of 1.6 should be applied to wind loads calculated according to ASCE 7-05 and reduced by a directionality factor  $K_d$ . For DLC 6.1 in large wind turbine structures, a wind directionality factor of 0.95 is recommended for this calculation. The directionality factor  $K_d$  is not to be applied to IEC 61400-1 partial load safety factor.

<sup>b</sup> For design load case DLC 1.1, given that loads are determined using statistical load extrapolation at prescribed wind speeds between  $V_{in}$  and  $V_{out}$ , the partial load factor for normal design situations shall be  $\gamma_f = 1.25$ .

Regarding special safety factors relative to

Table 5-3, lower partial safety factors for loads may be used where the magnitudes of loads have been established by measurement or by analysis confirmed by measurement to a higher than normal degree of confidence. The values of all partial safety factors used should be properly stated in the design documentation.

#### 5.4.3.4 Power production (DLC 1)

In this design situation, a wind turbine is running and connected to the electric load. Unlike conventional building structures, *WTGS* are subject to loads generated from the dynamic operation of the wind turbine machinery. While the IEC 61400-1 design load cases consider many operational design load cases, the *local building code* load combinations do not explicitly consider these. For this reason, when the *local building code* is used for compliance verifications of the design basis of *WTGS* support structures, this should be put in light of IEC 61400-1 Design Load Cases (DLCs).

As *WTGS* are subject to high-cycle fatigue loading, fatigue loading should be considered in the design of *WTGS* towers and foundations. The fatigue loading should represent operational conditions considering a variety of possible wind speed regimes and other operational events.

#### 5.4.3.5 Power production plus occurrence of fault or loss of electrical network connection (DLC 2)

This design situation involves a transient event triggered by a fault or the loss of electrical network connection while the turbine is producing power and is significant for wind turbine loading. Some *WTGS* are subject to operational or abnormal operational fault loads considered in the IEC 61400-1 standards that exceed the *local building code* extreme wind loads. Further, the *local building code* most likely has no method or provisions for assessing these potentially governing design loads. For this reason, compliance with the local building code alone may not necessarily produce an adequate tower design or produce a design that meets wind industry standards. It is imperative that the Design *Engineer* coordinate with the *turbine manufacturer* to determine whether there are loading conditions that potentially exceed the *local building code* extreme wind or earthquake loads. Fatigue loading should also be considered.

#### 5.4.3.6 Parked standing still or idling (DLC 6)

Beyond *cut-out* wind speeds and for extreme wind events, wind turbines are generally parked with the rotor brake engaged or idling (i.e. rotor blades are free to spin in the feathered position) to minimize loads on the structure. DLC 6.1 may be evaluated to comply with ASCE 7-05. For this compliance verification, wind speed and load conditions described in Sections 5.3.4, 5.4.6, 5.4.8 and 5.4.9 should be performed.



#### 5.4.3.7 Other relevant conditions

Other relevant conditions included in the design load cases (DLCs) in Table 5-2 are:

- Start-up
- Normal shut-down
- Emergency shut down
- Parked (standstill or idling)
- Parked plus fault conditions
- Transport, assembly, maintenance and repair

#### 5.4.3.8 Special load case verifications (as applicable)

##### 5.4.3.8.1 Assessment of the topographical complexity of the site

If topography does not meet the following indicators of Table 5-5 given by IEC 61400-1, then a complex terrain assessment needs to be performed. For gentle changes in terrain ASCE 7-05 could be used to determine the increase or decrease in wind speed with respect to the position of the wind turbine and the topographic feature. For cliffs or abrupt changes in terrain more advanced models are needed, including use of wind tunnels or computational fluid dynamics as advised by a wind engineer.

**Table 5-5: Terrain complexity indicators**

Distance range from wind turbine	Maximum slope of fitted plane	Maximum terrain variation from a disc with radius $1.3 z_{hub}$ fitted to the terrain
$< 5 z_{hub}$	$< 10$ degrees	$< 0.3 z_{hub}$
$< 10 z_{hub}$		$< 0.6 z_{hub}$
$< 20 z_{hub}$		$< 1.2 z_{hub}$

##### 5.4.3.8.2 Assessment of wake effects from neighbouring wind turbines

Wake effects produced by neighbouring wind turbines during power production should be considered including single or multiple wakes from upwind machines. This should include effects of spacing between machines for all operational wind speeds and wind directions.

Wake effects produce a reduction in the mean wind speed and an increase in the turbulence intensity. The increase in loading can be considered by the use of an effective turbulence intensity that account for discrete and turbulent wake effects.

Recommendations for the calculation of effective turbulence intensity, and the calculation of wake effects from neighbouring wind turbines are given in Annex D of IEC 61400-1.

##### 5.4.3.8.3 Assessment of other environmental conditions

The following environmental conditions should be compared to to the assumptions made in the design of a wind turbine:

- Normal and extreme temperature ranges
- Icing, hail and snow
- Humidity

- Lightning
- Solar radiation
- Chemically active substances
- Salinity

#### 5.4.4 Seismic loading and design criteria

##### 5.4.4.1 General

This section presents criteria for the design of *WTGS* subject to earthquake ground motions. At sites with increased seismic hazard *WTGS* have a reasonable likelihood of being in an operational state during an earthquake and may also be subjected to simultaneous earthquake and emergency stop loads if a shutdown is triggered by the earthquake. In addition to the earthquake load combinations in the *local building code*, the *WTGS* support structure design should consider load combinations that include operational loads plus earthquake loads. Seismic design criteria and load combinations may be in accordance with *Certification Agency Guidelines*, as recommended in this section, or as justified by rational engineering.

##### 5.4.4.2 Seismic ground motion values

Seismic ground motion values should be determined per ASCE 7-05 Section 11.4 or the site-specific ground motion procedures set forth in ASCE 7-05 Chapter 21 (as permitted in ASCE 7-05 Section 11.4.7). For load combinations that do not include operational loads the spectral response acceleration parameter should be based on 1% damped values, due to the low inherent damping of typical *WTGS* steel support structures. Larger spectral damping values may be considered for use at the *Engineer's* discretion given proper justification. Table 5-6 indicates that a multiplicative spectral adjustment factor,  $B$ , equal to 1.40 should be used to adjust spectral response acceleration,  $S_a$ , from 5% (standard IBC value for determining  $S_a$ ) to 1% damped values. For load combinations that include operational loads the spectral response acceleration parameters should be based on 5% damped values. This increase in damping is based on the aerodynamic damping inherent to an operating *WTGS*, as verified by experimental and numerical results showing that a damping level 1% produces overly conservative results [Prowell, 2011]. Caution should be exercised in selecting the appropriate level of damping when software capable of simulating aerodynamic damping is used in analysis and design.

**Table 5-6: Spectral Response Damping Adjustment Factor,  $B$**

Damping (%)	$B^1$
5%	1.00
4%	1.05
3%	1.13
2%	1.23
1%	1.40
<sup>1</sup> Factor calculated per ASCE 41-06 Section 1.6.1.5.1	

##### 5.4.4.3 Geologic hazards and geotechnical investigation

Consideration of seismic forces should be included in the foundation design for areas with historical earthquake activity. Evaluation of earthquake effects should be performed in

accordance with local building codes, or IEC 61400-1 requirements. Guidance in seismic loading evaluation is provided in the ASCE 7-05 standard which, by reference, is part of the building codes in the majority of U.S. jurisdictions. Earthquake loads should be evaluated based on ground motion parameters and response spectra required by the applicable local building code. Where the IBC is the applicable building code, seismic design parameters should be provided in all geotechnical reports, regardless of whether the project is located in a seismically active region or not. Building codes in most jurisdictions are based on, or default to, the IBC.

Where IBC code governs, geotechnical evaluation of earthquake effects should include, but not be limited to, the following:

- Ground shaking
- Liquefaction
- Slope instability
- Surface fault rupture
- Seismically induced settlement/cyclic densification
- Lateral spreading
- Cyclic mobility
- Soil strength loss

Liquefaction susceptibility analysis may be performed using state-of-the-art analytical and empirical procedures based on SPT, CPT or shear wave velocity of the subsurface materials. Appropriate mitigation should be provided for foundations located in areas where analysis indicates susceptibility to earthquake effects noted above. The selected method should be at the Geotechnical *Engineer* or foundation Designers discretion, but within the wind industry and project location standard of care.

Where a project is located near active faults, turbines should be located with adequate setbacks from the fault zone as established by the local building code or defined in consultation with AHJ. The characteristics of the fault including type, seismic setting, subsurface conditions, ground motion attenuation, and maximum earthquake magnitude that can be generated from the fault should be considered. Ground shaking should be accounted for appropriately using analysis procedures provided in ASCE 7-05 or in accordance with local building code requirements. The seismic design category for each project should be assigned and the seismic loading analysis procedure selected accordingly with consideration of site specific spectral accelerations, structural period, and dynamic characteristics.

Where relatively loose unsaturated cohesionless soils are present at a given site, the effect of ground shaking from a design level earthquake should be taken into account. Potential settlement due to cyclic densification of the site soils should be evaluated.

#### **5.4.4.4 Performance Objectives**

Building code seismic design requirements do not ensure that structures will be operational after a design level earthquake. Similarly, a WTGS support structure designed using this *Recommended Practice* may be damaged during an earthquake beyond a level that is economically repairable, or turbine components may be rendered inoperable by the earthquake induced shaking. This level of performance may not present a significant risk to human life due to the relative frequency that WTGS are occupied and the remote location of many wind farms, but the potential economic losses may represent an unacceptable risk to the wind farm owner. Enhanced performance objectives, such as operational performance after a design level earthquake, may be established to meet specific owner requirements. However, a clear distinction should be made between the required minimum performance objectives of the *local*

*building code* (life-safety) versus that of any supplementary, project-specific contractual agreement.

A performance factor (similar to an importance factor of 1.5 for essential facilities) may be established to improve expected behavior during and after an earthquake. A major consideration in establishing this performance factor is coordinating with the *WTGS* manufacturer to establish acceleration thresholds for turbine components that will ensure operational performance (e.g. operational performance if nacelle acceleration during an earthquake is limited to some maximum value). Using advanced analysis techniques and the established turbine component thresholds the *Engineer* can evaluate support structure options that will achieve these improved performance goals.

#### 5.4.4.5 Seismic Load Combinations

*WTGS* have a reasonable likelihood of being in an operational state during an earthquake and may also be subjected to simultaneous earthquake and turbine emergency stop loads if a shutdown is triggered by the earthquake. ASCE 7-05 seismic load combinations do not include consideration of concurrent earthquake and turbine operational loads. It is of critical importance to recognize that seismic plus operational loads may in some cases govern tower and foundation design. Therefore, for engineering “best practices” it is suggested to evaluate seismic plus operational load combinations, regardless of the absence of a codified requirement. The following “best practices” load combinations including seismic plus operational loads are recommended and should be considered in addition to ASCE 7-05 prescribed load combinations:

Seismic Load Combination:

$$U = (1.2 + 0.2S_{DS})D + 0.75(\rho Q_E + 1.0M) \quad (\text{Eq 5-5})$$

$$U = (0.9 - 0.2S_{DS})D + 0.75(\rho Q_E + 1.0M) \quad (\text{Eq 5-6})$$

where,

$D$  = dead load

$M$  = operational loading equal to the greater of: 1) loads during normal power production at the rated wind speed; or 2) characteristic loads calculated for an emergency stop at rated wind speed.

$Q_E$  = effect of horizontal seismic (earthquake-induced) forces

$S_{DS}$  = design spectral response acceleration parameter at short periods

$U$  = factored load effect

$\rho = 1.0$ , redundancy factor (for nonbuilding structures not similar to buildings  $\rho = 1.0$  per ASCE 7-05 Chapter 12.3.4.1).

Note that for the load combinations, the minimum specified value of the seismic response coefficient,  $C_s$ , per ASCE 7-05 Equations 15.4-1 and 15.4-2 may apply.

It is suggested that operational and earthquake loads be combined as an absolute sum with a load factor of 0.75. Use of a load factor of 0.75 on both the earthquake and operational loads is similar to a square root sum of squares type combination and is supported by results of response history analysis of wind turbines ranging from 65-kW to 5-MW, subjected to 100 earthquake ground motion records, and considering varying orientation of wind and earthquake loads (Prowell 2011). Alternatively, other methods may be used to combine operational and earthquake loads provided that they are justified by rational engineering analysis. Consideration

of site-specific prevailing wind direction and maximum earthquake component direction may be appropriate when the seismic hazard at a particular site is dominated by known faults, in which case no load factor may be applicable if wind and wave propagation directions are expected to coincide.

#### 5.4.4.6 Analysis Procedures

Any analysis procedure (equivalent lateral force, modal response spectrum analysis, or response history analysis) permitted by the *local building code* is acceptable for use with this *Recommended Practice*. Refer to the *local building code* or ASCE 7 for specific requirements for each analysis procedure.

If the equivalent lateral force procedure is used the vertical distribution of seismic forces should be calculated based on the procedure given in ASCE 7-05 Chapter 12.8.3 with the following modifications. The effective seismic weight of the nacelle and rotor should be assumed to be located at the turbine's center of gravity, and the effective seismic weight of the tower structure (including ladders, platforms, railings, etc.) should be distributed to nodes located at tower can joints. Seismic forces should also be assumed to act at these locations.

ASCE 7-05 Table 15.4-2 presents response modification factors,  $R$ , for various nonbuilding structures not similar to buildings, but does not explicitly include WTGS support structures. This *Recommended Practice* suggests the use of  $R = 1.5$  unless a different value is justified by rational engineering analysis that is reviewed and accepted by the *Engineer of Record* and building official. The use of the suggested  $R = 1.5$  factor does not necessarily imply the expectation for ductile response or material overstrength, but accounts for items such as conservatism in the seismic response coefficient  $C_s$  for non-building structures, particularly when design is driven by high seismic forces, the calculation of element capacities for structures sensitive to buckling failure, and soil-foundation-structure interaction, among others.

In practice, often only the peak seismic loads and peak operational loads are available. As a result, the proposed combination method for operational and seismic loads may be an overly conservative approach, especially considering that the respective peak loads do not occur at the same instant of time and in the same loading direction. Seismic response history analysis, considering time varying earthquake ground acceleration and operational or emergency stop loads, can be used to more accurately predict response and reduce potential design conservatism. Response history analysis results should be evaluated with respect to the performance objectives outlined in Section 5.4.4.4. Seismic response history analysis procedures should conform to the requirements of ASCE 7-05 Chapter 16. It is suggested that any such analysis be conducted with analysis software capable of simulating both structural response and global turbine dynamics, including aerodynamic interaction.

Guidance on appropriate tower drift and displacement limits for local building code compliance is given in Section 7.7.2.

#### 5.4.5 Assessment of soil conditions

Each wind project should have a site-specific geotechnical study to determine geotechnical parameters for the proposed foundations and associated load transfer mechanisms. The Geotechnical *Engineer* should conduct the work with the degree of skill and care exercised by other Geotechnical Firms working in the wind energy industry with consideration of geotechnical standards in the region that the services are performed.

##### 5.4.5.1 Geotechnical Document Review

A review of available geotechnical and geologic documentation should be conducted as part of the geotechnical investigation scope of work. Typical documentation review includes the following, as applicable:

- Historical and current aerial photographs,
- Published regional geologic maps,
- Soil survey reports,
- Groundwater hydrology data and maps,
- Landslide mapping,
- Solution cavity (sinkhole) mapping
- Mine subsidence mapping
- Seismic hazard mapping,
- Slope stability analysis, if determined necessary
- Other applicable geotechnical and geologic documentation.

#### **5.4.5.2 Geotechnical Exploration**

Geotechnical exploration for each turbine site should consist of at least one exploration point per foundation, or more as necessary to characterize soil and bedrock conditions within the foundation influence zone. As a general guide, subsurface exploration points should be located within the footprint of the proposed turbine foundation. Geotechnical exploration should be of a sufficient depth in order to determine subsurface characteristics within the foundation influence zone. For shallow foundations, exploration should also be a minimum depth at least equal to the foundation base width. If refusal is encountered at shallower depths in high strength soils, not all explorations need always be continued to the full depth, at the discretion of the Geotechnical *Engineer* in consultation with the designer. For deep foundations, exploration should be at least the maximum anticipated foundation depth, plus an additional 20 percent.

In-situ exploration methods, including cone penetration testing, flat plate dilatometer testing, vane shear testing, and other in-situ methods should be supplemented by an appropriate amount of soil borings in order to correlate in-situ data with laboratory testing.

#### **5.4.5.3 Geophysical Testing**

Geophysical testing, including seismic velocity testing, local gravity, and other methods, often proves useful to assist in determining soil properties for turbine foundation design. Geophysical investigations should be carried out by a licensed professional with specific experience in the geophysical method to be used. Geophysical methods should only be used to supplement the subsurface exploration program and never be used as the only means of geotechnical exploration.

Seismic testing, including downhole seismic, Seismic CPT, and surface methods should be conducted at a representative number of sites in order to determine shear and compression wave velocity of the subsurface materials. The shear and compression wave velocities can then be used to determine dynamic shear modulus and be input into dynamic analyses of the foundation.

Other geophysical testing methods may be used to investigate presence of groundwater, subsurface voids, locate geologic discontinuities, interpolate between exploration points, and many other aspects of wind farm development.

#### **5.4.5.4 Groundwater Considerations**

Effects of groundwater should be accounted for in the turbine foundation design, which may require relatively long term monitoring of groundwater levels at the specific foundation locations during the geotechnical investigation. Long term groundwater levels should be incorporated into stability, bearing capacity and other pertinent foundation design evaluations.

The geotechnical *engineer* should determine the design groundwater level, which should take into account seasonal fluctuations as well as long-term groundwater levels. The foundation design should account for any effects of buoyancy resulting from the design groundwater level. The design groundwater level may or may not vary across the site.

#### 5.4.5.5 Geotechnical Laboratory Testing

Laboratory testing should be conducted on samples from soil borings gathered during the subsurface exploration program to determine engineering properties for design of the proposed foundations. Laboratory testing should be sufficient to characterize all soil types and layers that may have an impact on the foundation design. The following laboratory tests should be included in the soils laboratory testing program, as applicable:

- Moisture content and unit weight
- Plasticity indices
- Grain size analysis
- Shear strength (unconfined, triaxial, direct shear, vane shear, etc.)
- Consolidation
- Compaction characteristics (maximum unit weight, optimum moisture content, etc.)
- Corrosivity characteristics (Sulfate, chloride, pH, resistivity, etc.)
- Other geotechnical laboratory testing as appropriate.

#### 5.4.6 Assessment of Wind Loads Applied Along the Tower Mast

As indicated in Section 5.4.1, wind loads on the rotor-nacelle assembly are generally larger than wind loads applied along the tower mast. Manufacturers may consider the drag force coefficients on the tower using European standards. For compliance purposes with U.S. AHJs, the *Engineer* should verify whether extreme wind loads applied along the tower mast have been considered in DLC 6.1. Force coefficients for round tubular structures from ASCE 7-05 Figure 6-21 (for Chimneys, Tanks, Rooftop equipment & Similar structures) should be used. The surface finish of wind turbine towers should be considered as moderately smooth. Depending on the total tower height to diameter ratio (i.e.  $h/D$ ) these coefficients will generally vary from 0.6 to 0.7.

#### 5.4.7 Assessment of Frequency Separation

To avoid resonance, *WTGS* should be designed with sufficient separation between system natural frequencies and turbine operational frequencies. The calculation of *WTGS* system natural frequency should account for the mass and stiffness properties of the turbine, tower, and foundation. The operational frequencies should include the turbine primary rotor operational frequency (i.e., the “1xp” frequency) and the blade-pass frequency (e.g., the “3xp” frequency, for a 3-blade turbine). Any other significant loading known to act as a harmonic forcing function should also be considered.

Frequency separation criteria apply to separation from sustained operational speeds. Transient operational speeds that violate separation criteria for a short time may not necessarily have sufficient dwell time to cause resonance. For example, on turbine start-up, one or more turbine operational frequencies typically pass through a system natural frequency. In fact, for most typical *WTGS* (3-bladed upwind *HAWT*) in going from 0 rpm up to its operational speed, the 3xp frequency most likely passes through the system fundamental frequency. However, the short dwell time of the varying operational speed near the system fundamental frequency is not sufficient to excite resonance. Since resonant response (such as very large tower top displacements or accelerations) could damage the tower and trigger turbine fault conditions, it is imperative that the *Engineer* discuss any suspected frequency separation issues with the *Turbine Manufacturer* considering both sustained and transient operational speeds.

Many *turbine manufacturers* install test or prototype turbines in the field for verification of various operational parameters including frequency separation. Prototype verification data may be used in lieu of analytical frequency calculations.

Where applicable, frequency separation should comply with the *Certification Agency Guidelines*. In the absence of such criteria, the following may be applied, which closely approximate the frequency separation criteria in [GL, 2003]:

1. Approximate fundamental period methods such as that in ASCE 7 Section 12.8.2.1 should not be used for determining frequency separation. The system natural frequencies should consider the stiffness and mass properties of the entire *WTGS* system, which includes the turbine, tower, and foundation. The calculated nominal system frequencies should be varied by 5% to account for tolerances in design assumptions and calculations. Alternatively, to account for variations, the system natural frequencies may be represented by an upper bound (i.e., stiff/rigid) estimate and a lower bound (i.e., soft/flexible) estimate. The upper bound frequency may be calculated on the basis of a minimum system mass estimate with an assumption of an infinitely rigid foundation. The lower bound frequency estimate may assume the maximum system mass estimate with the maximum turbine mass moment of inertia value and the minimum permissible foundation rotational stiffness value.
2. The system natural frequencies should have a minimum 5% separation from the operational frequencies. To account for the recommended 5% tolerance in calculated values, the total minimum separation would be 10%, i.e., 5% separation plus 5% tolerance. Separation by 5% or less may be considered a high risk resonance condition and may not be acceptable, but vibration mitigation strategies described in some *Certification Agency Guidelines* may be considered. General wind industry experience has shown that 15% minimum frequency separation is quite adequate and preferred, since almost no significant instances of tower resonance have been observed or reported at that amount of separation margin. The calculated system natural frequencies should preferably have 15% minimum separation from the turbine operational frequencies. As a minimum a 10% separation should be used. Separation between 5% to 10% may indicate risk of resonance, and engineering discretion is advised. Separation by 5% or less may be considered a high-risk resonance condition and may not be acceptable, but vibration mitigation strategies described in some *Certification Agency Guidelines* may be considered.

#### **5.4.8 Assessment of structural integrity by reference to wind data**

For the rotor-nacelle assembly, when the 50-year extreme wind climate accounting for any local effects (topography, wake effect from neighboring turbines, exposure/turbulence) is found to comply with the reference wind speeds of Table 5-1, outside of hurricane prone regions, the turbine is suitable for the site.

Reference to wind data and determination of 50-year recurrence periods, as established by ASCE 7-05, should comply with the following:

*Outside hurricane-prone regions:*

Wind speeds from ASCE 7-05 wind map (Figure 6-1 of same Standard) can be used as reference value to be compared with Table 5-1 standard wind turbine classes.

Any less stringent wind speeds than those defined in ASCE 7-05 wind map, and from regional climatic data should only be used when:

1. Approved extreme-value analysis has been employed
2. Length of record, sampling error, averaging time, anemometer height, data quality, and terrain exposure of anemometer have been taken into account.



*In hurricane-prone regions:*

The use of regional wind speed data obtained from anemometers should not be permitted for the 50-year wind speed definition.

Any less stringent wind speeds than those defined in ASCE 7-05 wind map, should account for the following:

1. Approved simulation and statistical analyses.
2. Design wind speeds resulting from the study should not be less than the 500-year return period divided by  $\sqrt{1.5}$ .

Wind directionality effects on hurricanes and thunderstorms should be considered in light of possible large yaw misalignment (i.e. yaw moments) and likelihood of non-operational yaw-drive (e.g. loss of power network), as discussed in Section 5.3.4.

In addition, fatigue loads are assessed to assure a minimum design life can be achieved. Under this circumstance, the support structure may be designed with loading data from the pertinent standard wind turbine class, usually provided by the manufacturer. Specific verification for normal (mean) wind speed probability density function in the design of the wind turbine is provided in IEC 61400-1 (2005) Section 11.9.

**5.4.9 Assessment of structural integrity by load calculation with reference to site-specific conditions**

For the support structure, structural integrity can be demonstrated by comparison of loads for the site-specific conditions with those used in the design basis of the standard wind turbine class. In regards to verification of loads for extreme conditions, while any rational method should be permitted, the following minimum verification is recommended. The extreme wind associated with the IEC 61400-1 site class rating should be compared to the ASCE 7-05 design wind. The comparison should consider all applicable ASCE 7-05 wind parameters including the wind exposure, wind profile, turbulence intensity and topographic factor.

The ASCE 7-05 extreme wind is defined as a 3-second gust, 50-year wind at 10 meter height. Further, the ASCE 7-05 wind load factor of 1.6 when adjusted by the directionality factor for round structures is approximately 1.52 (wind directionality factor  $K_d = 0.95$  is recommended for DLC 6.1). In comparison, IEC 61400-1 Design Load Case (DLC) 6.1 is a 3-second, 50-year wind at hub height with a design load factor of 1.35. For this reason, it is recommended that IEC 61400-1 DLC 6.1 with ASCE 7-05 load factor of 1.52 be used to verify compliance with *local building code* extreme wind loads.

In addition, IEC 61400-1 state specific verification for ultimate and fatigue effects produced by wake effects from neighbouring turbines for design load cases 1.1 and 1.2 should be considered.

## **6 Materials**

For material specifications, see the materials section for the specific structure type.

## 7 Tower Support Structure

This section, herein referred to as this *Recommended Practice*, addresses the structural design of towers in *WTGS* and apply to the support structure types defined in this *Recommended Practice*. This section applies to steel *fabricated tubular* towers of circular cross section. Where towers are of polygonal cross section, e.g., 24-sided, this section may apply, but the *Engineer* is cautioned to use sound engineering judgment to determine the extent of applicability, especially where, for example, specific equations are derived for a circular cross section. Other tower concepts, such as concrete or hybrid concrete-steel towers are being considered for a future revision of this *Recommended Practice*. Lattice or space-frame towers are not part of the scope of this *Recommended Practice*.

At this time, *local building codes* are not sufficiently specialized for *WTGS* tower design and as such may not necessarily be appropriate to serve as a basis for tower design. Nevertheless, in the current regulatory process of structural permitting, a *WTGS* project may be subject to the design requirements of the *local building code*. For the purpose of complete tower design, full compliance with *Certification Agency Guidelines* is recommended as a design basis, followed by design validation against *local building code* requirements. Where a proven tower design already exists in service, e.g., already installed and in production operation overseas, and was designed in accordance with *Certification Agency Guidelines*, a limited design assessment or plan review to show compliance with the *local building code* may be considered sufficient. However, the required extent of the design assessment with respect to satisfying the *local building code* is generally determined or established by the *AHJ*. Any less stringent standard or provision from *Certification Agency Guidelines* should not be used to undercut or violate the *local building code* requirements, unless the *Engineer* has been granted permission to do so by waiver from the *AHJ* or another agency with the appropriate authority.

Similarly, any less stringent standard from the *local building code* should not undercut or violate the *Certification Agency Guidelines*. If the situation is unavoidable, the *Engineer* should report the conflicting condition to the owner or client. In the event of conflicting standards, the *local building code* should prevail; however, it is the owner's or client's responsibility to determine the effect of *local building code* compliance on the conditions of commercial certification.

### 7.1 Materials

The following lists represent materials currently in common use in the wind industry. This list is not exhaustive, nor should it be construed to prohibit unlisted but otherwise suitable materials.

Tower Shell:

- ASTM A36: Carbon structural steel.
- ASTM A572: High-strength structural steel.
- ASTM A709: Structural steel for bridges.
- EN 10025-2 S235: Structural steel
- EN 10025-2 S355: Structural steel
- EN 10025-3 S355: Structural steel

Tower Splice Flanges and Base Plates:

- ASTM A694
- EN 10025-3 S355
- Cut or formed from plate: See Tower Shell steels listed above.

#### Opening Stiffener Plates:

- ASTM A694
- EN 10025-3 S355
- ASTM A572: High-strength structural steel
- ASTM A709: Structural steel for bridges

#### High Strength Bolts:

- ASTM A325: Structural bolts
- ASTM A490: Structural bolts alloy steel
- EN 14399-4: High-strength structural bolting assemblies for preloading - Part 4: System HV - Hexagon bolt and nut assemblies (M12 to M36) together with EN 14399-6: High-strength structural bolting assemblies for preloading - Part 6: Plain chamfered washers.
- DAST Guideline 021: Hot dipped galvanized bolt assemblies (M39 to M64)

Tower flanges, base plates, base rings and stiffener plates can be subject to lamellar tearing due to stress acting perpendicular to the plate surface and also due to through-thickness strain from restrained weld shrinkage. Mitigative measures include tensile tests perpendicular to the product such as per ASTM A770, EN 1993-1-10 or UT testing of the base material after welding. The *Engineer* may coordinate with the *Turbine Manufacturer* to determine a preferred method.

Material toughness is of special concern in WTGS due to conditions such as fatigue and fracture due to operational loads in cold weather environments. Fracture toughness testing may be done in accordance with ASTM E1820-11: Standard Test Method for Measurement of Fracture Toughness. See Section 9 and 10 for other quality assurance conditions during fabrication, installation and operation of wind turbine towers.

## 7.2 Strength Design

In this *Recommended Practice*, *strength design* is the recommended design methodology. This maintains compatibility with International practice and follows recommended practice in the U.S.

In general, design strength may be calculated in accordance with the following:

- Certification Agency Guidelines, if applicable
- AISC Provisions [AISC, 2005] for steel design.
- Eurocode 3: Design of steel structures
  - EN 1993-1-1 : General rules and rules for buildings
  - EN 1993-1-6 : Strength and stability of shell structures
- DIN 18800 [DIN-18800], 2008-11 for steel design. It should be noted that as of this writing, this DIN standard is scheduled to be superseded by the corresponding EN standard in the near future.

In general, fatigue strength may be calculated in accordance with the following:

- Eurocode 3: EN 1993-1-9 [EC3-9, 2005] for fatigue design of steel structures.
- AISC Provisions [AISC, 2005] for fatigue design of steel structures, subject to the recommendations in Section 7.3.
- Where fatigue design of steel components, such as anchor rods, overlaps with concrete components, refer to the Foundation Section for fatigue design of concrete.

Design strength of *fabricated tube* towers may be calculated in accordance with *Certification Agency Guidelines*, or design standards that address thin shell tubes such as EN 1993-1-6 or DIN 18800. Where design strength is to be calculated in accordance with U.S. design standards, the following issues should be considered:

1. Use of AISC provisions for round tubes and pipes may be problematic for fabricated tube tower design on several accounts: the design provisions have explicitly stated limits of applicability to only HSS sections; the maximum  $D/t$  slenderness ratio considered in the AISC provisions is limited to a maximum of  $0.45E/F_y$ , which is routinely exceeded in WTGS towers; the available axial compressive strength based on flexural buckling is not easily determined for a tapered fabricated tube with varying cross sectional wall thickness (i.e., the so-called “stepped column” problem), which cascades into further complicating the calculation of the flexure and axial force interaction.
2. Past U.S. and European tower design practices have drawn from established design standards for other similar structures. In particular, having close structural similarities to fabricated tube towers is the steel stack (chimney-type) structure, whose design in the U.S. is governed by the ASME steel stack standard [ASME, 2006]. The aforementioned European steel thin shell design provisions and the ASME stack standard share a similar design approach. Where local buckling governs, as in virtually 100% of all practical fabricated tube towers, flexural and axial stress are combined into a single normal stress. That normal stress is compared against the local buckling capacity of the thin shell at the considered location. The European standards have a *strength design* format whereas the ASME standard uses a working stress design format (i.e., allowable stress design).

For the reasons stated, the following provisions are assembled from U.S. standards and may be used to satisfy the requirement that design strength be calculated in accordance with U.S. standards. AISC’s LRFD format is used. The procedure in [Troitsky, 1990] is used but with the upper transition slenderness limit modified according to [ASME, 2006]. Shear and torsion interaction are according to [Galambos, 1998]. The resulting equations are identical to many of the AISC provisions but not subject to the AISC limits of applicability to HSS only.

AISC provisions are necessarily favored because they are reference standards in ASCE 7 and the IBC and would therefore more easily facilitate local building code compliance. Use of a single standard such as [ASME, 2006], as preferred by some designers, would also be acceptable from a design standpoint.

### 7.2.1 Compressive Strength

The tower shell subject to compression should meet the following condition:

$$f_u \leq \phi_c F_n \quad (\text{Eq 7-1})$$

Where,

$$f_u = P_u/A + M_u/S \quad (\text{Eq 7-2})$$

$P_u$  = Design vertical force, usually equal to  $-F_z$ . Note that the sign should be consistent with the sign of the flexural stress component.

$A$  = Area of tower cross section.

$M_u$  = Design moment, usually  $M_{xy}$ .

$S$  = Elastic section modulus of tower cross section.

The design compressive strength,  $\phi_c F_n$ , should be determined as follows:

The nominal compressive strength,  $F_n$ , should be the lowest value obtained according to the limit states of yielding, flexural buckling, or local buckling.

$$F_n = F_{cr} \quad (\text{Eq 7-3})$$

$$\phi_c = 0.90$$

Slenderness parameters:

$\lambda = D/t$  where  $D$  is the outside diameter of the tower shell and  $t$  is the shell thickness.

$$\lambda_1 = 0.11E/F_y$$

$$\lambda_2 = 0.357E/F_y$$

$\lambda_{MAX}$  = No maximum value is specified, but it is rare in most practical tube towers to find slenderness values in excess of 330.

For  $\lambda \leq \lambda_1$

$F_{cr}$  should be the smaller of the following:

$$F_{cr} = F_y \quad (\text{Eq 7-4})$$

$F_{cr}$  due to flexural buckling calculated in accordance with “stepped column” procedures such as those in [Barnes, 1979] or [Newmark, 1943].

For  $\lambda_1 < \lambda \leq \lambda_2$

$$F_{cr} = QF_y \quad (\text{Eq 7-5})$$

$$\text{where } Q = 0.038E/[F_y(D/t)] + 2/3 \quad (\text{Eq 7-6})$$

For  $\lambda_2 > \lambda \leq \lambda_{MAX}$

$$F_{cr} = 0.276E/(D/t) \quad (\text{Eq 7-7})$$

### 7.2.2 Shear Strength

The tower shell subject to transverse shear should meet the following condition:

$$f_{vu} \leq \phi_v F_{vn} \quad (\text{Eq 7-8})$$

Where,

$$f_{vu} = V_u/A_v \quad (\text{Eq 7-9})$$

$V_u$  = Design shear force, usually equal to  $F_{xy}$ .

$A_v$  = Shear area equal to half the gross area,  $A_g/2$ .

Equations for the critical shear buckling stress of cylindrical shells can be derived from Section 14.3.3 of [Galambos, 1998]. The results are identical to AISC Equations G6-2a and G6-2b. Therefore, this *Recommended Practice* recommends the use of those AISC equations for the calculation of shear strength of round fabricated tube towers.

The design shear strength,  $\phi_v F_{vn}$ , should be determined as follows:

The nominal shear strength,  $F_{vn}$ , should be the lowest value obtained according to the limit states of shear yielding and shear buckling.

$$F_{vn} = F_{cr} \quad (\text{Eq 7-10})$$

$$\phi_v = 0.90$$

$F_{cr}$  for circular fabricated tubes should be determined as the larger of the following:

$$F_{cr} = \frac{1.60E}{\sqrt{\frac{L}{D} \left(\frac{D}{t}\right)^{\frac{5}{4}}}} \quad (\text{Eq 7-11})$$

And

$$F_{cr} = \frac{0.78E}{\left(\frac{D}{t}\right)^{\frac{3}{2}}} \quad (\text{Eq 7-12})$$

but  $F_{cr}$  should not exceed  $F_y/\sqrt{3}$ ,

Where,

$L$  = Length between stiffened tower cross sections, e.g., tower section length between splice flanges.

$D$  = Tower wall outside diameter.

$t$  = Nominal tower wall thickness.

Note that  $F_{cr}$  as defined above acts on a cross sectional shear area equal to half the gross area,  $A_g/2$ .

### 7.2.3 Torsional Strength

The tower shell subject to torsion should meet the following condition:

$$f_{Tu} \leq \phi_T F_{Tn} \quad (\text{Eq 7-13})$$

Where,

$$f_{Tu} = T_u/C \quad (\text{Eq 7-14})$$

$T_u$  = Design torsional moment, usually equal to  $M_z$ .

$C$  = Torsional section modulus,  $J/r$ , where  $J$  is the polar moment of inertia and  $r$  is the distance to the center of rotation.

Equations for the critical torsional buckling stress of cylindrical shells can be derived from Section 14.3.3 of [Galambos, 1998]. The results are identical to AISC Equations H3-2a and H3-2b. Therefore, this *Recommended Practice* recommends the use of those AISC equations for the calculation of torsional strength of round fabricated tube towers.

The design torsional strength,  $\phi_T F_{Tn}$ , should be determined as follows:

The nominal torsional strength,  $F_{Tn}$ , should be the lowest value obtained according to the limit states of torsional yielding and torsional buckling.

$$F_{Tn} = F_{cr} \quad (\text{Eq 7-15})$$

$$\phi_T = 0.90$$

$F_{cr}$  for circular fabricated tubes should be determined as the larger of the following:

$$F_{cr} = \frac{1.23E}{\sqrt{\frac{L}{D} \left(\frac{D}{t}\right)^{\frac{5}{4}}}} \quad (\text{Eq 7-16})$$

And

$$F_{cr} = \frac{0.60E}{\left(\frac{D}{t}\right)^2} \quad (\text{Eq 7-17})$$

but  $F_{cr}$  should not exceed  $F_y/\sqrt{3}$ ,

Where,

$L$  = Length between stiffened tower cross sections, e.g., tower section length between splice flanges.

$D$  = Tower wall outside diameter.

$t$  = Nominal tower wall thickness.

#### 7.2.4 Combined Torsion, Flexure, Shear and/or Axial Force

The tower shell subject to combined forces should meet the design condition as for the force or moment acting alone and also the following conditions:

$$f_{vu}/(\phi_v F_{vn}) + f_{\tau u}/(\phi_\tau F_{\tau n}) \leq 1.0 \quad (\text{Eq 7-18})$$

and

$$\begin{aligned} \text{for } f_{\tau u}/(\phi_\tau F_{\tau n}) \leq 0.20 \\ f_u/(\phi_c F_n) \leq 1.0 \end{aligned} \quad (\text{Eq 7-19})$$

$$\begin{aligned} \text{for } f_{\tau u}/(\phi_\tau F_{\tau n}) > 0.20 \\ [f_u/(\phi_c F_n)]^2 + [f_{vu}/(\phi_v F_{vn}) + f_{\tau u}/(\phi_\tau F_{\tau n})]^2 \leq 1.0 \end{aligned} \quad (\text{Eq 7-20})$$

The 20% torsional shear trigger for interaction with normal stresses is used similar to that of the AISC provisions. However, in contrast to AISC, this *Recommended Practice* has elected to use elliptical interaction of the normal and shear forces for reasons including: historical performance of *WTGS fabricated tube* towers indicates no obvious need for conservatism with respect to shear stresses; some degree of consistency with EN 1993-1-6; and there may be conservatism in the approach that considers the normal stress as the sum of the axial compression stress and a dominant flexural stress against design resistance derived from only axial compression.

### 7.3 Fatigue Strength

Investigating fatigue strength for a WTGS involves the consideration of complex loading combinations due to the responses of the turbine and the supporting structure to the varying nature of wind. There are no industry accepted simplified methods for determining fatigue loading appropriate for large wind turbine (LWT) support structures. Conservative assumptions regarding fatigue are too costly considering the number of structures often involved in WTGS projects and also considering that fatigue loading is often the governing loading consideration for many components of the supporting structure.

Most WTGS are modelled as a complete system using complex software simulators coupled with nonlinear structural and fluid dynamic models. The simulators model the entire WTGS, from the flexible blades of the rotor to the support structure itself. In many cases, testing is used to verify or supplement the results of a simulation.

The IEC Standard outlines specific operating and loading conditions for investigating fatigue strength. The simulators generate turbulent winds that allow the determination of the load ranges



and number of cycles that can be expected over the life of the WTGS. The results are specific to a given WTGS. Changes to the support structure, such as height, stiffness or attaching appurtenances may significantly affect the results of a simulation. The IEC standard recommends that a minimum 20-year life be considered for WTGS.

Most fatigue investigations for the supporting structure involve analyzing the data generated from a simulation and comparing the results to published fatigue life curves (S-N curves) for the critical components of the supporting structure. The loading sequences generated by the simulation generate a cyclic loading history. The number of cycles associated with each load range is determined using established methods of analyzing data such as the Rainflow Counting procedure outlined in ASTM E1049, "Practices for Cycle Counting in Fatigue Analysis". The results are summarized in a load range spectrum which provides the frequency of occurrence for all load ranges. The load range spectrum is generally provided in the *turbine manufacturer's* loads document for the WTGS.

Fatigue investigations are based on elastic analysis methods using unfactored operating loading conditions. AISC specifies stress ranges based on "service loads," i.e., loads with a load factor of 1.0. The EN standard specifies a fatigue load factor of 1.0. While the load factor requirement is the same, it is important to note that unlike AISC, the EN and IEC standards apply further partial safety factors to the fatigue resistance. These partial safety factors are discussed in detail below in a later section.

The design focus is to consider the number of load applications, the stress ranges and the types and locations of critical structural components in order to prevent the initiation of a fatigue crack or the propagation of a fatigue crack from a defect, discontinuity or stress concentration. Fracture mechanics may also be used to establish stress levels to minimize the potential for brittle failure considering loading rate, temperature, material toughness and the expected discontinuities from fatigue loading or from the fabrication process.

The AISC and AWS standards contain special fabrication, inspection and installation requirements for fatigue sensitive structures that should be followed for WTGS supporting structures. *Turbine manufacturers* may also supplement these requirements with more stringent requirements.

### 7.3.1 S-N Curves

S-N curves are most often presented as log-log plots with the allowable or nominal stress range on the vertical axis and the allowable number of cycles on the horizontal axis (refer to Figure 7-1). The use of a log-log plot allows for the simplified representation of an S-N curve as a series of straight lines with different slopes. The variable "m" is commonly used to designate the inverse slope of a line on an S-N curve.

Most S-N curves corresponding to defined construction details or components categories account for stress concentrations and are intended to be compared to calculated nominal component stresses without the application of additional stress concentration factors (SCF). S-N curves for structural steel components generally transition into a fatigue threshold or cut-off zone at a low stress range. Stress ranges at or below this threshold value may be repeated for an indefinite (infinite) number of cycles without initiating fatigue damage.

EN Standard 1993-1-9 (EN) and the AISC Specification for Structural Steel Buildings (AISC) publish a family of S-N curves for various component categories. The basis of the S-N curves are identical; however, the EN standard has established additional S-N curves that fall between the AISC S-N curves that allows for a finer categorization of components with respect to their notch sensitivity (refer to Figure 7-1).

The EN and AISC S-N curves are based on research by Keating and Fisher (1986) and are based on identical confidence and probability levels. The EN family of curves include additional size

effect factors and considerations for non-welded and stress relieved welded components. Although some detail requirements vary between the EN and AISC component categories, the basic concepts of both standards are the same.

The EN S-N curves are designated using Detail Categories (DC) that are equal to the nominal stress range at 2 million cycles for each category. The AISC S-N curves for direct stress are designated using letters starting with A for the least notch sensitive category to E for the more severe notch sensitive category. Category F is used to define the S-N curve for shear stress.

The EN and AISC S-N curves indicate a fatigue threshold stress range below which an indefinite number of constant amplitude cycles may be applied without initiating fatigue damage. The EN S-N curves also indicate a cut-off stress range at 100 million cycles that may be used when damage summation methods are used to investigate fatigue strength. Summation methods are useful when a stress range spectrum is available that provides the magnitude and frequency of each stress range expected. Stress levels below the cut-off may be ignored in the summation; however, some Certification Agency standards require that the cut-off limit be conservatively ignored, resulting in all stress ranges contributing to the damage summation. The AISC fatigue threshold stress ranges are intended to be used with constant amplitude stress ranges and are not appropriate to be used as a cut-off stress range when using a summation method.

One significant difference between the EN and AISC S-N curves is the magnitude of the stress range and the number of cycles at the constant amplitude fatigue threshold limit (refer to Figure 7-1). The EN fatigue threshold limit is set equal to the nominal stress range at 5 million cycles for all detail categories. The number of cycles at the AISC S-N fatigue threshold limit varies between 2 to 22 million cycles depending on the notch severity of the component category.

### **7.3.2 Strength Resistance Factors**

The AISC allowable stress ranges are intended to be used with a strength resistance factor equal to 1.0 based on the reliability level used to establish the S-N curves and the special material and inspection requirements for fatigue sensitive structures. The EN standard requires a partial safety factor (reciprocal of strength resistance factor) to be applied as a safety factor to the S-N curve nominal stress ranges. The EN partial safety factors for fatigue strength varies between 1.00 and 1.35 depending on the consequence of failure and the level of inspection.

The IEC standard provides a further refinement compared to the EN Standard. IEC separates the partial safety factor for fatigue strength into two components specifically for use in WTGS; one based on the importance of a component in the WTGS and one based on material considerations. A 1.15 partial safety factor for importance (component class 2) applies to the components of the supporting structure. The partial safety factor for material varies between 0.9 and 1.1 depending on the level of inspection for fatigue damage as indicated in Table 5-3. For many WTGS it is not practical to implement a comprehensive inspection program for all components of the supporting structure; therefore, IEC partial safety factors of 1.15 and 1.1 are commonly used resulting in a combined partial safety factor of 1.26. The IEC partial safety factors are specific to WTGS and override the EN partial safety factor of 1.35. The IEC 1.26 combined partial safety factor is equivalent to an AISC strength resistance factor of 0.79.

The AWS D1.1 Structural Welding Code prior to 1996 had a provision to use a 0.80 strength resistance factor for non-redundant structures (Ref AWS C-2.14.4). This provision was discontinued due to the reliability basis of the specified S-N curves and due to the special material and fabrication inspection requirements for fatigue sensitive structures.

### **7.3.3 WTGS Simulations**

The dynamic simulation of a WTGS produces the data used to determine the expected load ranges at various locations on the supporting structure and the number of cycles associated with each load range. The load ranges are often reported with specific mean load values. The table

of load cycles tabulated according to load range versus load mean is known as a Markov matrix and is the result of the Rainflow count for a given load component. The mean load value does not significantly affect the fatigue life for most structural components; therefore, the number of cycles for a load range is commonly determined by summing all the cycles for the load range, regardless of their mean load level. For components that may have a non-linear relationship between loading and stress (i.e. prestressed bolts), the mean load level is required to properly assess the required fatigue strength.

In order to determine fatigue damage, nominal stress ranges in critical components from the applied load ranges must be determined using an elastic analysis. The stress ranges in each critical component along with their associated allowable number of cycles are used to determine demand-to-capacity ratios (DCR). A DCR value of unity or less indicates adequate fatigue strength. Care should be taken to distinguish between a DCR that is a stress ratio versus a DCR that is a cycles ratio. The former has the conventional meaning of a design allowable stress utilization while the latter has the meaning of design lifetime utilization.

The DCR for a component is generally determined by a damage summation method or by assessing stress ranges. The Palmgren-Miner's Summation method (Miner's Rule) is the most commonly used damage summation method. Assessment of stress ranges is accomplished by calculating a damage equivalent load (DEL) which is then used to determine the constant amplitude stress ranges in the supporting structure. Each method is described in the following paragraphs.

#### 7.3.4 Miner's Rule Summation

A Miner's Rule summation involves totalling the calculated accumulative affects of fatigue damage from the load cycles determined from a WTGS simulation.

Miner's Rule summation assumes that the fatigue damage from each load range is accumulative and that the incremental fatigue damage from a specific load range equals the ratio of the number of cycles that the load range occurs to the total number of cycles allowed. The summation of these cycles ratios for all load ranges becomes the fatigue demand-to-capacity ratio (DCR) which is also often referred to as the "Total Damage Ratio".

Miner's Rule summation may be expressed using the following equation:

$$DCR = \sum \frac{n_i}{N_i}$$

where:

i = load range number

$n_i$  = number of cycles for load range i

$N_i$  = allowable number of cycles for load range i

#### 7.3.5 Damage Equivalent Loads

The damage equivalent load (DEL) method involves the calculation of a damage equivalent load defined as the constant amplitude load range producing a constant amplitude stress range that theoretically would result in the same DCR found using Miner's Rule summation.

The calculation and use of a DEL assumes that the incremental fatigue damage of a particular load range from a simulation can be converted to an equivalent incremental load range occurring with a different number of cycles. A given load range is converted to an incremental DEL at the same number of cycles by assuming a constant slope log-log relationship between load ranges and cycles of loading. The DEL concept may be expressed by the following equation:

$$DEL = \left[ \frac{\sum [(n_i)(\Delta R_i)^m]}{N_d} \right]^{1/m}$$

where:

i = load range number

$n_i$  = number of cycles of load range  $\Delta R_i$

$\Delta R_i$  = load range for range i

m = assumed inverse slope of log-log relationship

$N_d$  = selected number of cycles to determine DEL, i.e., the DEL's reference cycles

Various slopes are assumed for the log-log relationship. The assumption is that the slope that most closely represents the S-N curve for the components under investigation will result in the most accurate DCR. Typically a loads document provides DEL values based on a range of assumed slopes. For structural steel, it is common to use the DEL calculated with a slope of 3 when investigating direct stresses and a slope of 5 or 6 when investigating shear stresses.

The DEL is used to determine the stress in the critical components of the supporting structure. The stresses are considered constant amplitude stress ranges and are compared to allowable S-N curve stress ranges for the number of cycles equal to the DEL reference cycles. The DCR becomes the ratio of the calculated stress range to the allowable stress range.

Although the DEL method is considered a more approximate method, it has the advantage of allowing a simple analysis of a supporting structure for determining conformance to local building code requirements. Another advantage is that DEL's can facilitate easy fatigue load comparisons. Large amounts of fatigue load data in range-and-cycle format can be converted to corresponding DEL's with the same number of reference cycles and then easily compared by magnitude. Due to the assumptions associated with the DEL method, its use should be limited to components having a linear relationship between loading and stress.

By definition, a DEL is only valid for a single value of m, so an S-N curve cut-off cannot be considered when using a DEL. The DEL used for an analysis should be based on a number of cycles that will not fall within the fatigue threshold zone of the S-N curves for the components under investigation. If this occurs, an erroneous conclusion may be made that a component has adequate fatigue life if the calculated constant amplitude stress range is below the fatigue threshold stress range. If a lower number of cycles were used to determine a higher magnitude DEL, the computed constant amplitude stress range may fall above the S-N curve for the component indicating inadequate fatigue strength.

Further, a DEL should only be used along with a single-slope S-N curve with the same slope parameter m value as used to derive the DEL. Therefore, it is imperative that the DEL reference cycles are chosen such that they fall in a segment of the S-N curve with the same slope parameter m as the DEL and also that the number of cycles does not fall in the threshold segment of the S-N curve, i.e., the flat slope as described above. For these reasons, the procedures in the following paragraph are recommended.

For steel structures, it is recommended that DEL's reported in a loads document that are based on more than 2 million cycles be converted to a higher magnitude DEL at 2 million cycles. This will avoid the issue of the calculated constant amplitude stress ranges falling into the fatigue threshold zone for structural components and details typically used in WTGS (refer to Figure 7-1).

Since a uniform slope is assumed, the DEL from a loads document may be converted to an equivalent DEL at 2 million cycles for a specific slope using the following equation:

$$DEL_2 = (DEL) \left[ \frac{N}{2 \times 10^6} \right]^{1/m}$$

where:

$DEL_2$  = damage equivalent load based on 2 million cycles

DEL = damage equivalent load reported in a loads document

N = number of cycles used for determination of the DEL, i.e., the DEL's reference cycles

m = the inverse slope used for the determination of the DEL

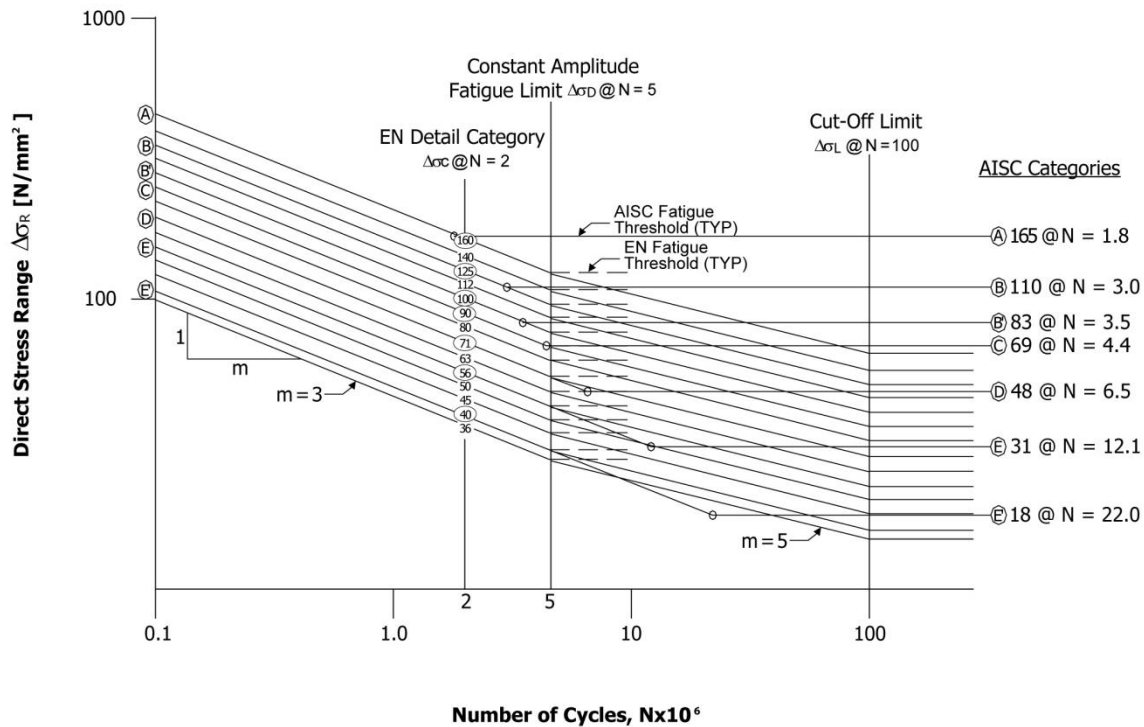


Figure 7-1: EN and AISC Fatigue Strength Curves

#### 7.4 Special Analysis by Finite Element Analysis (FEA) Methods

When required by the Certification Agency Guidelines or the *Engineer*, the special analysis may be performed in accordance with the following sections.

##### 7.4.1 Top Flange Eccentricity Analysis

When connected to the tower top flange, turbine yaw bearings are known to load the top flange in a geometrically eccentric manner. These load eccentricities are not necessarily accounted for in a typical analysis based on “mirrored flange” contact. The stresses induced by eccentric yaw bearing loads may be investigated using the methods described in [Frese, 2000].

#### 7.4.2 Hotspot Analysis at Shell Penetrations

Hotspots, i.e., locations of stress concentration, occur at tower shell penetrations, abrupt change in cross section and other geometric discontinuities, other stress risers, etc. Hotspot stresses for fatigue design of welded joints and components may be determined in accordance with [IIW, 2003].

#### 7.4.3 Buckling Analysis

The effect of shell penetrations on tower buckling capacity may be determined in accordance with *Certification Agency Guidelines*. In the absence of such rules, the buckling analysis procedures in EN 1993-1-6 may be used. Alternatively, any rational analysis procedure may be used, but due consideration should be given to nonlinear effects, in the absence of which buckling capacity may be overestimated. A procedure that considers geometric and material nonlinearity with imperfections in the shell's initial shape would be acceptable.

#### 7.4.4 Section Splice Connections

##### 7.4.4.1 Bolted Splice Flanges

Bolted splice flanges may be designed in accordance with *Certification Agency Guidelines*, where applicable. At this time, this *Recommended Practice* recognizes no U.S. design standard that is sufficiently specialized to serve as a design basis for bolted splice flanges. For this reason, FEA is recommended as a possible design option with recognition that flange manufacturing tolerances, gaps, and imperfect contact reduce the real strength of the joint. Alternatively, the following European documents may serve as a design basis for the strength and fatigue design of bolted splice flanges: [Petersen, 1998], [Schmidt, 1997], and [Seidel, 2001].

##### 7.4.4.2 Alternative Connections

Alternative tower section splice connections such as bolted shear connections or field welded joints should be designed in accordance with the standards applicable to similar connection details in the tower.

#### 7.5 Tower Internal Components

In addition to the tower primary structure (e.g., tower shell, splice and base flanges, and shell penetration reinforcement), the tower internal components often include miscellaneous structural details such as service platform framing, connection and support brackets, ladders, equipment and cable supports, service lift carrier beams, stairs, handrails, guardrails, etc. Some tower internal components may be governed by the *local building code*, and the *Authority Having Jurisdiction* may require structural documentation for these items.

Alternatively, Occupational Safety and Health Administration (OSHA) standards for such items should be acceptable. Like other industrial facilities or utility plants, there should be no unauthorized public access to the tower. Consequently, *local building code* provisions intended for use in conventional buildings may result in some degree of over-design. For these reasons, use of OSHA standards for platforms, ladders, etc., would be appropriate and acceptable.

In practice, it is common for tower internal components to fall under separate design scope from the primary tower structure. The connection to the tower wall is the interface between the primary tower structure and the miscellaneous tower internal components. In these instances, the design of connections to the tower should be considered part of the tower internal component design, and the tower internals *Engineer* should verify that the specified connection is compatible with the fatigue detail category of the tower wall.

### 7.5.1 Connections to the Tower Wall

In addition to considering the required strength of the connections to the tower wall, the connection *Engineer* should determine that the connection detail is compatible with the fatigue detail category of the tower wall. Where subject to fatigue loading, the fatigue resistance of the attachment itself should also be evaluated.

### 7.5.2 Platforms

*Local building code* loading requirements or OSHA regulations should apply. For determining required live load, service platforms are generally not considered to be part of an exit pathway. The displacement criteria for platform members should be at the discretion of the *Engineer*.

The design of steel platform framing and decking should meet AISC design requirements. Aluminium components should meet [AA, 2000] design requirements. The contact between dissimilar metals should be separated to prevent galvanic-series corrosion.

### 7.5.3 Ladders

*Local building code* or OSHA regulations should apply. All ladder components including support brackets and connections in the load path should be designed to meet code loads and the required fall arrest system forces. Where the ladder system also supports cables or equipment, those loads should be considered in the design.

### 7.5.4 Stairs, Handrails, and Guardrails

*Local building code* or OSHA regulations should apply.

### 7.5.5 Other Support Framing

Beams and other support framing should be designed to meet AISC requirements if steel or AA requirements if aluminium. The connections to the tower wall should meet applicable strength requirements and should be compatible with the fatigue detail category of the tower wall.

### 7.5.6 Tuned Mass Dampers

Where a Tuned Mass Dampers (TMD) is used for vibration mitigation, it may be designed in accordance with the methods outlined in [Faber, 2008] or other rational methods at the discretion of the *Engineer*. Where displacement due to extreme wind loads or design earthquake forces exceed the TMD's rated displacements for effective damping, the TMD may be assumed to be ineffective and only the TMD mass need be considered in the design.

### 7.5.7 Internal Chambers

Internal chambers created by welding steel plate and bulkheads to the tower wall should be verified to be consistent with the tower wall's fatigue detail category. Examples of internal chambers include sand chambers, oil or coolant reservoirs, spill containment floors, internal bulkhead or divider walls, etc.

## 7.6 Inspection and Testing Requirements

Where compliance with *Certification Agency Guidelines* is required, the testing and inspection requirements of the *Certification Agency* should apply.

Where compliance with *local building code* is required, the testing and inspection requirements of the *local building code* should apply. Where the *local building code* provides no guidance, IBC Chapter 17 should serve as the basis for the minimum inspection and testing requirements. See Section 9 and 10 for inspections during fabrication, installation and operation.

## 7.7 Coordination with Local Building Code

### 7.7.1 General

Since the international standards such as IEC 61400-1 and the *Certification Agency Guidelines* represent a more detailed and specialized design basis for wind turbine support structures, it is recognized that compliance with the regulatory requirements of the *local building code* may not necessarily require the extent of technical detail and rigor contained in the specialized standards. For this reason, the following design assessments are recommended to provide a baseline design assessment, especially for *AHJs* whose primary goal is the structural design review of the support structure to determine *local building code* compliance. The following design assessments are recommended:

1. Frequency separation: While not a typical concern for building-type structures, avoiding resonance is a primary design concern for *WTGS* support structures. See Section 5.4.7.
2. Wind design strength: Design strength against extreme wind load combinations may be calculated in accordance with Section 7.2. The *local building code* design wind may be reconciled with IEC 61400-1 site class ratings as indicated in Section 5.4.8 and 5.4.9.
3. Earthquake design strength: Design strength against seismic load combinations may be calculated in accordance with Section 7.2. The *local building code* design earthquake requirements may be reconciled with IEC 61400-1 earthquake requirements as indicated in Section 5.4.4.
4. Fatigue strength: Fatigue strength may be evaluated in accordance with Section 7.3.
5. Inspection and testing: Inspections and testing requirements may be evaluated in accordance with Section 7.6.

### 7.7.2 Drift limits

Local building codes may often specify drift or displacement (i.e., lateral deflection) limits for structures under earthquake or wind loads. For example, ASCE 7-05 Table 12.12-1 specifies allowable story drifts for a variety of structures. However, at this time, this document recommends no specific drift or displacement limits for *WTGS* towers. It is recommended that the *Engineer* and *Turbine Manufacturer* coordinate to specify any needed drift or displacement limits required for proper turbine operation and performance. The *Engineer* and/or *AHJ* is advised to defer to *Turbine Manufacturer*-specified drift or displacement limits (if any) since local building code criteria may not necessarily be appropriate for towers.

There are several reasons that drift and displacement limits are not currently specified in modern wind industry tower design practice. Towers are designed against ultimate and fatigue limit states, with design loads derived from a full transient analysis taking account different operating and fault conditions such as normal production, parking, start-up, stop, emergency stop, oblique inflow, network faults, failing brake, etc. The simulation is made for deterministic and turbulent wind conditions. The main output includes: time series quantities of forces, moments, displacements, etc., at different locations throughout the turbine and tower; and system natural frequencies and mode shapes. For project sites in regions of significant seismicity, the tower is typically checked by applying the modal response spectrum analysis (MRSA) procedure. Earthquake design loading along the tower is superimposed again with a transient analysis for specific operational and fault conditions. The tower is designed against the resultant forces and moments. Other items consider tower displacements. Wind turbine controls monitor and limit the possible tower top accelerations to prevent exceeding the design loading and as such limit the stresses and displacements implicitly. Certification Agency requirements include the following: consideration of displacement-related P-Delta secondary effects; consideration of initial tilt due to erection stacking tolerances and foundation settlement; and consideration of foundational flexibility in determining tower displacements.



Further insight is gained by examining the basic reasons for structure drift and displacement limits. Such limits seek to maintain structural integrity: (1) by avoiding inelastic damage and vertical instability due to excessive deformations; (2) by limiting damage to fragile non-structural elements such as ceilings, wall cladding, and glazing; (3) by avoiding vibration and issues related to motion perception and discomfort of occupants; and (4) by preventing damaging contact (i.e., impact) between adjacent structures. Clearly, in tower design, these reasons are either addressed by some portion of the analysis and design procedures or are simply not applicable.

It is concluded that the thorough analysis and design considerations of the aforementioned ultimate and fatigue limit states implicitly limit displacements. Moreover, many of the commonly cited justifications for drift limits do not seem to apply to WTGS towers. Therefore, in keeping with current wind industry tower design practices, no specific limits for drifts or displacements need to be defined.

### **7.8 Structural Performance under Fire-Exposed Conditions**

Where the tower support structure is required to have a minimum fire endurance rating by the local building code, AHJ, Owner or Owner representative if the specified fire endurance is based on the limiting or critical temperature of the structural material(s), it should be ensured that the load-carrying capacity of the tower support structure at fire-exposed temperatures properly accounts for the load ratio associated with the structure, where the dead load will generally far exceed the other gravity loads.

## 8 Foundations

At this time, *local building codes* are not sufficiently specialized for *WTGS* foundation design and as such should be supplemented by *Certification Agency Guidelines* and other international codes deemed better suited for a particular design aspect. Nevertheless, in the current regulatory process of structural permitting, a *WTGS* project may be subject to the design requirements of the *local building code*. For the purpose of complete foundation design, full compliance with *Certification Agency Guidelines* is recommended as a design basis, followed by design validation against *local building code* requirements. The required extent of the design assessment with respect to satisfying the *local building code* can only be determined by the *AHJ*. Any lesser standard or provision from *Certification Agency Guidelines* should not be used to undercut or violate the *local building code* requirements, unless the *Engineer* has been granted permission to do so by the *AHJ* or an agency with the appropriate authority.

Similarly, any lesser standard from the *local building code* should not undercut or violate the *Certification Agency Guidelines*. If the situation is unavoidable, the *Engineer* should report the conflicting condition to the owner or client. In the event of conflicting standards, the *local building code* should prevail; however, it is the owner's or client's responsibility to determine the effect of *local building code* compliance on the conditions of certification.

### 8.1 Materials

The following lists represent materials currently in common use in the wind industry. This list is not exhaustive, nor should it be construed to prohibit unlisted but otherwise suitable materials.

Reinforcing:

ASTM A 615

Cement:

ASTM C 150

Aggregates:

ASTM C 33

Fly Ash and Other Pozzolans:

ASTM C 618

Air Entraining Admixture:

ASTM C 260

Chemical Admixtures:

ASTM C 494

Embedment Plate:

ASTM A 36

ASTM A 572

ASTM A 588

Anchor Bolts:

ASTM A354 Grade BD

ASTM A 615

ASTM A 722

### 8.2 Limit States

Foundations should be designed or evaluated for ultimate limit states, serviceability states and fatigue limit states. Loading and factored load combinations applicable to various limit states for

foundation design are those covered in Table 5-2, Table 5-3, Table 5-4 of Section 5.4.3, and seismic load combinations of Section 5.4.4. The IEC 61400-1 Standard outlines specific operating and loading conditions for investigating fatigue limit states. The simulators generate turbulent winds that allow the determination of the load ranges and number of cycles for moments and shears at tower base that can be expected over the life of the WTGS. The results are specific to a given WTGS. The load factors and factored load combinations for foundation design are typically specified in the foundation load document supplied by *turbine manufacturers*. As a minimum, ASCE 7-05 load combinations and seismic load combinations given in Section 5.4.4.5 should be met. A number of more specific recommended practices for meeting the requirements of foundation limit states are discussed below.

### **8.2.1 Load Factoring**

The foundation should be designed to resist the internal forces and moments resulting when the factored loads are applied to the foundation, as stipulated in section 15.2.1 of [ACI, 2008]. Note that the resulting forces and moments may be significantly different than those resulting from applying the load factor to the forces and moments resulting from the unfactored loads.

### **8.2.2 Ultimate Limit States**

Foundation structural elements should be proportioned and designed to have adequate strength to resist the most critical factored load combinations to ensure the structural safety of the foundation. Ultimate limit states of structural elements include ultimate strength of concrete, reinforcing steel, anchor bolts, prestressing elements, grouts and embedment rings. Ultimate limit states may also include stability against overturning, stability against sliding, soil bearing capacity, ultimate axial capacity of piles, drilled shafts and rock anchors, and lateral capacity of piles and drilled shafts. However, the non-structural elements are more typically designed on the basis of allowable capacity under non-factored loads.

### **8.2.3 Serviceability Limit States**

All foundations should be analyzed to verify their serviceability under operation loads is met. Serviceability limit states may include foundation settlement, tilt, ground gapping, foundation stiffness, crack width, soil cracking and foundation movements.

### **8.2.4 Fatigue Limit States**

Fatigue analysis should be performed to verify that concrete, reinforcing steel, prestressing steel, anchor bolts, and grout have adequate fatigue strength to resist the cyclic fatigue loads prescribed by wind *turbine manufacturer*. More specific recommended fatigue evaluation guidelines are discussed in Section 8.5.

## **8.3 Anchorages**

Tower anchorages have historically consisted of two types: embedded and bolted. Embedded tower anchorages comprise a short section of tower that is cast into the reinforced concrete foundation and then bolted to the remainder of the tower via a conventional tower flange-to-flange connection. Bolted tower anchorages comprise bolts attached to a flange at the base of the tower that are terminated in the mass of the reinforced concrete foundation using a steel ring plate, washers, and nuts. The bolts are commonly designed with post-tensioning and the flange is typically a T-flange that is welded to the tower shell. The tee rests atop a bed of grout which is used not only to level the tower during erection, but also to accommodate the very high stresses imparted by the tower base flange as a means of transition to the lower strength concrete in the foundation below. Spreader plates have been used to transition stresses from the tower base flange to the grout. Other anchorage configurations may be possible, but the foregoing has dominated *HAWT* tower anchorages for the past 25 years.

### 8.3.1 Embedded Anchorages

Embedded anchorages, with respect to the short tower portion, are subject to all the considerations and requirements of tower design. The method of embedded anchorage load transfer to the reinforced concrete is subject to conventional reinforced concrete design practice with due consideration for fatigue. The absence of preload mechanism, with respect to cyclic concrete stresses of changing sign, should be recognized and is often addressed in practice through means of provision of tensile load path in reinforcing only. This often leads to amounts of reinforcing that would exceed amounts anticipated based on ultimate stresses alone.

### 8.3.2 Bolted Anchorages

Bolted anchorage design includes the following elements:

- base flange
- grout beneath base flange
- concrete beneath the grout
- bolts
- washers
- nuts
- embedded ring plate

The listing is provided to highlight the potential interdependence of tower components with the remainder of the anchorage design, chiefly in consideration of prying forces and bolt / flange hole eccentricities which can introduce potentially damaging excess stresses into the various elements. Respecting this interplay turbine tower and base flange requirements such as life-cycle anchor bolt post-tension force and minimum bolt diameter should be recognized and included in specifications and design.

Apart from the above the tower and base flange elements are subject to all the considerations and requirements of tower design. The remaining elements are subject to conventional steel and reinforced concrete design practice with due consideration for fatigue.

In recognition of the high fraction of overall joint stiffness that can be attributed to the reinforced concrete, as well as the significant damage that can occur in concrete subject to cyclic loading with a high incidence of unloading bolted anchorages are almost exclusively designed as post-tensioned.

#### 8.3.2.1 Grout

Grout under the tower base flange should be designed to resist the applied loads with due consideration for fatigue including initial loads (post-tension force) in the anchor bolts. The designer should specify the required permanent strength as well as the strength required during construction (e.g. tower / turbine erection and anchor bolt post-tensioning). Grout should be designed or detailed in consideration of the interface with the tower base flange and service climatic conditions such as precipitation, freeze/thaw cycling, and use of de-icing chemicals. Reference is given to ACI 318-08, 351.1R-99 and 351.2R-94.

The high performance grouts used in the wind industry require special care in specifying and installing. Careful adherence to the grout manufacturer's installation procedures and the involvement of the grout manufacturer whenever possible is recommended.

#### 8.3.2.2 Anchor Bolts

Anchor bolts should be designed according to applicable standards for steel construction [AISC, 2005] with due consideration for fatigue loading, corrosion protection, the stiffness of the bolted

tower / reinforced concrete joint, and the load share of each of the elements (concrete and bolts). Bolt toughness should be considered for inclusion in material specification although it should be noted that the general state of practice is for there to be no toughness requirement. Because, in the instance of post-tensioned bolted anchorages, joint durability depends on maintenance of anchor bolt post-tension force a bolt post-tension force monitoring and maintenance program should be specified. When design moment from the tower anchorage exceeds bolt pre-tension, anchor bolts are subject to tension.

In practical terms the anchor bolt post-tension force specified is often set equal to 15 to 20% above the worst computed bolt tributary load from the tower for the extreme unfactored tower base overturning moment. Normally without need for further checking of the joint element load share, etc. this has been shown to be a reliable method of achieving a post-tension level that ensures compression in the concrete for the full range of operational loads while limiting stress ranges in the bolts to ensure their fatigue resistance.

It should be cautioned that loss of bolt preload from creep can be excessive if galvanized coating used on the faying surfaces of heavy plates exceeds 5 mils. High bolt preload will cause excessive creep and loss of bolt pretension.

### **8.3.3 Anchorage load transfer**

Anchorage shear and moment load transfer to the remainder of the foundation should be ensured for ultimate and fatigue loading.

The regions of pre-stressed and non-prestressed concrete and reinforcing should be identified and designed accordingly.

Little research is available on the performance of anchorages of the type and size found in modern utility-grade HAWT foundation construction.

#### **8.3.3.1 Shear / Pullout**

With respect to design for shear, often referred to as pullout, of the anchorage a variety of methods are currently in use. One method used by designers in the industry is found in the provisions of Chapter 6 of [PCI, 1999]. Another method employed includes [ACI, 2008] Chapter 11 provisions for columns and slabs that evaluate different numbers of angular sectors of the anchorage for vertical loading to seek the worst pullout condition. Yet another method is to consider anchorage vertical reinforcing as that of a round column and make evaluations per [ACI, 2008] Chapter 10 provisions in overturning. Due the differing strain levels at which concrete and mild reinforcing will reach their respective ultimate capacities in the subject manner of shear / pullout, if reinforcing steel is added to resist pullout of the anchorage it should be designed to resist the entire pullout force, as discussed in commentary section RD4.2.1 of [ACI, 2008], Appendix D and Chapter VIII of [PTI, 2006].

All of the above include efforts to ensure the development of added reinforcing into both the mobilized anchorage and the remaining foundation.

Design for fatigue in shear / pullout of the post-tensioned anchorage has been absent or inconsistent throughout the industry in the U.S. AISC Design Guide 1 and Transportation Research Board NCHRP Report 412 provide useful guidelines for fatigue evaluation of anchor bolts.

#### **8.3.3.2 Moment**

Adequate ability to transfer the applied moment from the tower anchorage to the foundation should be ensured for ultimate and fatigue loading according to recognized moment transfer methods such as those described for slab-column connection by the latest edition of [ACI, 2008]

with due recognition for the appropriateness of methods selected respecting the size of the footing elements and the availability of test data to underpin design methods.

#### **8.4 Reinforced Concrete Design**

Reinforced concrete should be designed per [ACI, 2008] for strength, serviceability and durability. Special attention should be given to preventing pedestal pullout, providing adequate moment and shear transfer at pedestal/slab junction, keeping bearing stress in the concrete and grout at the tower flange/ foundation interface within code limits, analysis of bursting forces in the post-tensioning anchorage zone and determination of the required reinforcement. Additionally, proper effective slab width considering stress concentration should be used in calculation of flexural moment and shear demands of the foundation mat.

Note that IEC 61400-1 contains loads and load cases related to conditions not contemplated by [ASCE, 2005]. Additionally, strength reduction factors of [ACI, 2008] differ from the partial safety factors of the design codes recommended by [IEC, 2005]. Future research on the inherent reliability assumptions of [IEC, 2005] and [IBC 2009 and ACI 2008] is required to reconcile the differences between the various codes. Until this research is available, it is left to the designer to ensure that the intended reliability of each of the different codes is met.

In current practice, the foundation loads are calculated according to [IEC, 2005] by the *turbine manufacturers* and provided for the foundation designer's use. Most foundation designers in the industry design the foundations to meet the requirements of [ACI, 2008] as a minimum. [IEC, 2005] requires that, when other national standards are used to calculate the capacity of members, the designer should ensure that the design results in a level of safety consistent with the standards intended by [IEC, 2005]. Some *turbine manufacturers* provide guidance on the topic and require different load factors to compensate for a perceived difference in reliability between [ACI, 2008] and what [IEC, 2005] requires. Similar measures may be required when a project requires certification as illustrated in IEC 61400-22.

#### **8.5 Fatigue Analysis**

Fatigue adequacy verification for concrete structures should be performed for both the concrete and for the reinforcement in separate analyses. In the absence of applicable U.S. building codes/standards, fatigue evaluation may be performed in accordance with one of the following referenced standards/codes: [DNV, 2007], Eurocode 2 and 3, [CEB-FIP, 1990] or [GL, 2003], unless *turbine manufacturer* has its specific recommendations. For fatigue analysis, the partial load factor on loads should be taken as 1.0 but additional factors should be applied per the standard used. It is recommended that the foundation fatigue evaluation comply with the fatigue criteria as defined in one of the above standards/codes. Partial safety factors for fatigue loads, materials, safety class and fatigue damage should be no less than those defined in the standards/codes, and in no instance should overall safety level for fatigue be less than as prescribed per the standard [IEC,2005].

#### **8.6 Considerations Specific to Certain Types of Foundations**

##### **8.6.1 Shallow Foundations**

Shallow foundations are defined in this context as a foundation system relying on dead weight to resist overturning loads. These foundations have numerous unique concerns as detailed below.

##### **8.6.1.1 Foundation stiffness**

Foundation stiffness requirements are of very high importance and in some instances may control the design of the foundation. If the stiffness requirements are not met by the design, the turbine's expected fundamental frequency may be different than anticipated during tower design. Overall foundation stiffness depends on the strength and stiffness parameters of the soil, and their interaction with the structural elements of the foundation. It is common for *turbine*

*manufacturers* to specify minimum rotational and/or translational stiffness values for wind turbine foundations. If specified, the stiffness of the foundation can be calculated assuming the soil is an elastic half space, or a semi-infinite continuum of soil idealized as an elastic material. The shear modulus of the soil should be determined from measurements taken at the project site from the geotechnical report. This small strain shear modulus should be reduced for the strain calculated or estimated to result from the wind turbine loading. Guidance for performing this calculation can be found in [DNV/Risø, 2002].

#### **8.6.1.2 Differential settlement or tilting**

Total and differential settlement should be kept to an acceptable level. Settlement should be calculated for the entire foundation influence zone and include immediate settlement, primary and secondary consolidation settlement, as well as seismically induced settlement. In the absence of limits specified by the *turbine manufacturer*, a maximum inclination of 3mm/m is recommended.

#### **8.6.1.3 Bearing Capacity**

The foundation support material should be evaluated to determine the ultimate and allowable bearing capacities. The allowable bearing capacity should include an adequate factor of safety per requirements of the applicable building code. In the U.S., bearing capacity is traditionally evaluated with allowable stress design approaches. Per [IBC, 2009], the factor of safety should be at least 3.0 in determining the allowable bearing capacity at service loads and fatigue loads, and 2.26 under unfactored extreme loads. Evaluation of bearing capacity should also include consideration of eccentric loading due to the turbine overturning moment and the resulting reduced foundation contact area. In the case of extremely eccentric loading (i.e. eccentricity in excess of 0.3 times foundation width), soil bearing capacity may be determined per [DNV/Risø 2002].

Evaluation of bearing capacity should take into account all soil layers that are within the influence zone of the foundation as determined by bearing capacity theories.

When calculating bearing capacity, the following considerations should be included:

- Eccentricity of the foundation/ Effective foundation area
- Design Groundwater Level
- Drained conditions
- Undrained conditions
- Bearing capacity factors
- Ultimate limit state approach (ultimate strength or Load and Resistance Factor Design) may be used for evaluation of foundation soil bearing capacity if it is permitted by the applicable building code.

#### **8.6.1.4 Overturning Resistance**

The foundations should be designed to provide adequate resistance to overturning due to loads imposed by the wind turbine and other conditions such as earthquakes. The required resistance level should be consistent with local building code requirements but the factor of safety (Resisting Forces/ Unfactored Overturning Forces) should not be less than 1.5. Generally only the dead weight of the structure, foundation, and backfill materials (when these are not susceptible to erosion and scour), should be considered in analysis of overturning resistance. If passive or shear resistances are considered they should be justifiable considering the degree that they can be mobilized before overturning could occur.

### **8.6.1.5 Ground Gap or Zero Pressure**

#### **8.6.1.5.1 Permanent Loads**

Under unfactored permanent or normal operating loads, contact pressure should be compressive under the entire foundation; i.e., no ground gap or zero pressures should occur. This ensures that the foundation stiffness remains adequate during normal operation loads and contributes to preventing the cyclic degradation of the foundation bearing materials. Permanent loads are defined in [GL, 2003] as DLCs 1.0 (power production under normal wind profile), 3.1 (start-up under normal wind profile) and 4.1 (normal shut-down under normal wind profile).

#### **8.6.1.5.2 Extreme Loads**

Under unfactored extreme loads, the ground gap should extend no further than the center of gravity of the foundation.

### **8.6.1.6 Sliding Resistance**

The foundations should be designed to provide adequate resistance to sliding due to loads imposed by the wind turbine and/or conditions such as earthquakes. The required resistance level should be consistent with applicable building code requirements but the factor of safety (Resisting Forces/Unfactored Driving Forces) should not be less than 1.5. Only the dead weight of the structure, foundation, and backfill soils above the foundation should be considered in analysis of sliding resistance.

## **8.6.2 Deep Foundations**

Deep foundations include drilled piles, drilled shafts and pier foundations that are post-tensioned or regularly reinforced, pile groups supporting concrete caps, and other proprietary foundation systems such the tensionless pier (mono-pier) foundation. Piles include driven piles, drilled shafts, bored piles, auger-cast piles, and micropiles. Other types of deep foundations not specifically mentioned herein may be used, provided that they can be substantiated by acceptable test data, calculations and other information relating to the structural properties and load capacity of such elements. Where building permit is required, the use of special type of deep foundations is also subject to the approval of the building official.

### **8.6.2.1 Safety Factors**

Appropriate safety factors should be applied to determine allowable axial capacities of deep foundations based on the design assumptions used and results of full scale load testing. Guidance for global and partial safety factors for deep foundations is provided in chapter 18 of [IBC, 2009]. Additional guidance is provided in other references. Partial resistance factors for a limit state design approach can be found in Transportation Research Board NCHRP Report 507.

### **8.6.2.2 Foundation Stiffness**

Foundation stiffness for deep foundations should be determined using soil structure interaction analysis or other suitable procedures.

Stiffness of single pile, pier and rock anchor can be determined on the basis of testing, or computer aided soil structure interaction analysis. Where piles or piers anchors are connected to a concrete cap, it should be demonstrated that the piles or piers anchors alone have adequate stiffness required for the foundation. The stiffness reduction due to group effect of piles and piers should be included in the determination of foundation stiffness.

The mono-pier foundation behaves as a very large diameter, short, rigid pile. The stiffness of the foundation which relies on both horizontal and vertical restraint of the earth materials surrounding it should be evaluated using finite element method or other appropriate methods.



Soil stiffness is strain-dependent and effects of strains on soil dynamic stiffness properties should be considered. Where geotechnical investigation indicates soil at site is susceptible to cyclic stress degradation, the reduction in soil stiffness properties should also be included in the foundation stiffness determination.

#### **8.6.2.3 Pile Fatigue**

It should be demonstrated through fatigue analysis that the piles are capable (both geotechnical and structural fatigue resistance) of withstanding the number of cycles expected during normal operation of the turbine.

#### **8.6.2.4 Overturning Resistance**

All deep foundations should be demonstrated by analysis that the foundation has adequate overall resistance to overturning moments (including the effects of lateral shear and torque).

For pile and pier foundations, the overturning resistance should be determined on the basis of allowable capacity of pile/piers including the group effects. The bearing resistance under concrete cap should not be included in the calculation of the foundation overturning resistance. The overturning moments induced by unfactored extreme wind loads should not exceed the allowable overturning resistance. Overturning resistance of pile and pier foundations connected to a structural mat should be evaluated considering the rotational restraint that the pile/pier group provides in the allowable axial tension and compression capacity of the piles or piers.

For the mono-pier foundation, the overturning resistance should be taken as a combination of passive earth resistance (above and below an equilibrium point of rotation), vertical side shear along the length of the foundation, shear resistance at the base and axial resistance at the base. The ultimate passive earth resistance and shear friction is derived from the principles soil and rock mechanics. A global safety factor against the unfactored, extreme wind load of at least 2.0 should be provided.

#### **8.6.2.5 Tension in Piles Under Permanent Loads**

Under unfactored permanent or normal operating loads, loads across the entire pile group should be compressive; i.e., no tension in any piles should occur. Alternatively, a precise analysis of fatigue with regard to the external load carrying capacity of the piles may be performed. Permanent loads are defined in [GL, 2003] as DLCs 1.0 (power production under normal wind profile) and 1.1 (power production under normal turbulence model).

#### **8.6.2.6 Axial Pile and Pier Capacity**

Pile and pier foundations should be designed to provide adequate capacity for axial loads imposed by the turbine. The design should demonstrate adequate skin friction to resist axial loads. End bearing resistance may be included in evaluating axial capacity depending on the pile or pier installation method or at the discretion of the *Engineer*.

Where applicable, the effects of *settlement and negative skin friction* (downdrag) should be accounted for in axial capacity calculation.

The best method for determining actual installed pile capacity is by static load test. Verification of pile capacity, when required by [IBC, 2009] or by project specification, may be conducted during installation based on dynamic measurements and/or pile wave equation analyses with prior approval by the *Engineer*. Dynamic formulae, (such as the EN formula), are not considered an accurate predictor of pile capacity.

#### **8.6.2.7 Lateral Capacity**

The lateral load carrying capacity of deep foundations should be determined using appropriate methods. Where beam on nonlinear elastic foundation method (e.g. p-y) is used, it should be

applied appropriately with material properties representative of the foundation support materials. Additionally, verification of lateral load carrying capacity by load tests may be required for driven piles per [IBC, 2009].

#### **8.6.2.8 Structural Design of Deep Foundations**

Concrete cap (mat) and other concrete elements (piles, piers) should be designed to comply with the strength, serviceability and durability provisions of [ACI, 2008]. Guidance for load factors is found in Section 8.6.1.9 of these guidelines. Alternatively, the deep foundation elements (steel piles, micropiles, piers) may be designed using the allowable stresses not exceeding those specified in Table 1810.3.2.6 of [IBC, 2009].

Where post-tensioning is utilized, foundations should be designed using the recommendations and requirements for prestressed concrete in the [ACI, 2008] and [ACI, 1993] as applicable. The analysis of the concrete and anchorages that comprise the foundation should consider: determination of the required post-tensioning forces that confirms that the foundation remains in compression; check of tension in the anchorages; analyses of the bearing stress in the concrete and grout at the tower flange/ foundation interface; analysis of bursting forces in the post-tensioning anchorage zone and determination of required reinforcement to resist said forces; and analysis of shear in the overall concrete section.

#### **8.6.2.9 Group Capacity**

Pile groups should include analyses of group interaction and modifications to group axial and lateral capacity. Contribution to lateral capacity from an embedded pile cap may be considered provided that it can be demonstrated that the pile cap can be sufficiently embedded to provide lateral resistance under all applicable loading conditions. For grouped deep foundation elements, the allowable working uplift loads should be calculated to meet the provision of Section 1810.3.3.1.6 of [IBC, 2009].

#### **8.6.2.10 Corrosion and Soil Erosion**

Deep foundations should be evaluated for corrosion of structural elements in contact with subsurface materials. Unless fabricated of corrosion resistant materials, corrosion evaluation for steel piling and pile cap connections should be performed in accordance with section 2203 of [IBC, 2009]. Consideration should also be given for corrosion of concrete foundation elements in accordance with ACI guidelines.

Where deep foundation is subject to erosion, depths of soil erosion or scouring should be considered based on appropriate hydraulic study.

#### **8.6.2.11 Mono-Pier Foundations**

The mono-pier foundation (such as the tensionless pier or rock socket) resists the applied horizontal loads and overturning moment mainly by horizontal passive resistance and vertical skin friction of the earth materials that surrounds the pier and to a much lesser extent by bearing on the base of the pier. The passive and shear resistance relationships of the earth materials should be based on rational methods utilizing data presented in the project interpretive geotechnical report. The construction means and methods must also be recognized and suitable to not compromise the soil properties determined by the Geotechnical *Engineer* and utilized for design.

### **8.6.3 Rock and Soil Anchored Foundations**

Post-tensioned, rock and soil anchor foundations consist of an upper reinforced concrete mat that have anchors installed by drilling a shaft and filling the shaft with a high strength anchor bolt and grout. The anchors are post-tensioned to develop an internal tension force in each anchor that is locked off by a nut bearing on a base plate atop of the concrete mat. Overturning moment loads are transferred through the concrete mat to the subgrade and anchors by soil structure

interaction that requires evaluation of the stiffness and strength of the subgrade and bond strength of the grout/earth interface.

#### **8.6.3.1 Overturning Resistance**

Overturning resistance for the post-tensioned, anchor foundation should be checked against the design overturning moment similar to a shallow foundation except that a portion of the restraining force due to the anchor post tension may be included in the resisting loads. The number of anchors mobilized for overturning resistance should be determined based on rational methods. A minimum factor of safety of 2 should be provided for overturning resistance at unfactored loads.

#### **8.6.3.2 Bearing Capacity**

The foundation support material should be evaluated to determine the ultimate and allowable bearing capacities in a similar fashion to a shallow foundation.

#### **8.6.3.3 Axial Anchor Capacity**

The geotechnical capacity of the anchor should be checked against pull-out with respect to the design tension load. The capacity should be evaluated based on representative values of the bond stress between the grout and the surrounding rock. Bond stress provides the primary mechanism for resisting pull out and is dependent on the rock type and characteristics (strength, rock mass modulus, weathering, discontinuities, etc.), and the method of grouting. The design bond stress should provide a minimum factor of safety of 2 for the rock/grout interface

The length of anchor within the rock that will resist the tension load is the bond length. After the bond length is determined, a calculation should be performed to check that there is enough soil/rock mass above the bond length to resist the design loads assuming a global failure of the rock mass. The global rock mass failure zone may be assumed to be an inverted cone with an apex angle of 60 degrees propagating from the middle of the bond zone to ground surface, unless a different angle is justified through a rational analysis. The anchor design should also include an adequate unbonded/stressing length to allow for re-stressing of the anchors.

The structural capacity of the anchor is limited by the allowable tension load on the anchor taken as 70% of ultimate strength of the anchor rod.

Guidance for design of rock or soil anchors can be found in the [PTI, 2005], and other documents such as [FHWA, 1999].

#### **8.6.3.4 Anchor Fatigue**

It should be demonstrated through fatigue analysis that the foundation anchors, including rock and soil anchors, are capable of withstanding the number of cycles expected during normal operation of the turbine considering the benefit of post-tensioning to reduce the cyclic stress fluctuation in the anchors. The reduction in stress fluctuation is dependent on the relative stiffness between the anchor system and the subgrade. Acceptable fatigue checks may be performed per this Guideline.

#### **8.6.3.5 Anchor Load Testing**

All anchors should be tested in accordance with [PTI, 2005]. All anchors should be proof-tested to 133% of the design post-tensioned load before lock-off. At least one anchor per foundation will be performance tested per PTI procedures with load and reload cycles.

The active length of the anchor is dependent on the distribution of transfer of bond stress and skin friction along the length of the anchor. At minimum, the equivalent elastic length of the anchor is the unbonded length of the anchor, but at maximum it should not exceed the unbonded length plus one half of the mobilized bonded length.

The visco-elastic creep at the anchor grout/ bond may be a concern depending on the type of earth materials encountered.

A program for monitoring the anchor post-tension during operation of the turbine should be undertaken.

#### **8.6.3.6 Design Post-Tension Load to Anchors**

The long-term, effective, post-tension load should be determined so that the concrete cap remains in contact with the subgrade during operational loads. The design lock off post-tension load should account for tension losses from visco-elastic creep.

#### **8.6.3.7 Post Tensioned Anchor Foundation Mat Structural Design**

The structural design of the reinforced concrete cap is similar to that of a shallow foundation except that the anchors provide points of restraint.

#### **8.6.3.8 Corrosion**

Rock and soil anchor foundations should be evaluated for corrosion of structural elements in contact with subsurface materials.

## 9 Fabrication and Installation

### 9.1 Scope

Fabrication and installation generally do not fall under the EOR's scope of work. The information contained in this section is with regards to the verification activities for the tower and foundation support structures during fabrication, pre-construction and during installation/construction. Inspections during *Commissioning* and operational phases of the wind farm are discussed in Section 10. The information provided in this section should not be construed to subsume these items (i.e., the means and methods of the Fabricator or Field Contractor) under the responsibility of the design *Engineer*. Engineering design responsibility and the associated design liability do not include the means and methods implemented by the tower Fabricator. Similarly, neither does engineering responsibility extend to the means and methods implemented by the erection or Field Contractor in installing the tower or building the foundation.

Nevertheless, in situations of real practice and as a basic matter of project cooperation, the *Engineer* is often called upon to provide engineering advice on related fabrication and installation issues, when requested by the various project players. The *Engineer* should preferably proceed in these cases only with sufficient understanding of the boundaries of individual liability and knowledge. In light of these conditions, the purpose of this section is to provide practical information regarding the common intersections of the otherwise separate scopes of work of tower/foundation engineering, fabrication, and installation/construction operations. In particular, items and issues that may affect the design life or design safety factor are specifically discussed.

### 9.2 Tower Fabrication and Installation

#### 9.2.1 Fabrication Tolerances

It is recommended that the structural design drawings incorporate tolerances requirement explicitly or by reference. Structural design drawings for local building code compliance may not show fabrication tolerances, however, tolerance information should be required on shop, assembly, or fabrication drawings. Where fabrication tolerances are not shown on the available drawings, the fabricator should coordinate with the *Engineer* and turbine and/or tower manufacturer to determine the required fabrication tolerances. In the case of conflicting specified tolerances, the fabricator should contact the *Engineer* and *turbine manufacturer*. Alternatively, the more stringent tolerance may be used where there is lack of agreement or clarity.

##### 9.2.1.1 Quality Assurance/Quality Control (QA/QC)

This section encompasses the general requirements of tower fabrication QA/QC including but not limited to the following items:

#### Inspection and Testing Requirements

- Review of material test Certified Mill Test Report (CMTR) or material mill certificates
- Visual inspection of raw or conditioned steel plates
- Review of supplementary tests results including Charpy V-Notch (CVN) tests
- Review of welding documentation such as weld procedure specifications (WPS) and procedure qualification reports records (PQR)
- Visual inspection Testing (VT) of welds
- Inspection of weld preparation
- Nondestructive testing (NDT) of welds by Magnetic- Particle Test (MT), Ultrasonic Testing (UT), or Radiographic Testing (RT) techniques
- NDT for lamellar tearing of plate material at highly restrained welded joints

Acceptance/Rejection Criteria

Repair Procedures

Reporting Requirements

### 9.2.1.2 Governing Inspection Criteria

Conflicts regarding QA/QC have been known in the wind industry to lead to legal disputes between the Fabricator and other project parties. Such disputes typically stem from the lack of agreement on the governing QA/QC standard. For this reason, it is imperative that project parties undertake a coordinated effort to establish mutually agreed upon governing QA/QC standards prior to tower fabrication.

The difficulty in establishing an agreed QA/QC standard may often stem from the mix of standards involved in the WTGS project, which may involve one or more of the following: Local Building Code, Certification Agency Guidelines, *turbine manufacturer's* proprietary tower specifications, *Engineer's* in-house specifications, and Fabricator's internal standards. Inherent to these standards are the reference to either U.S. standards or European international standards. Adding to the complexity of the situation, the basis in U.S. standards may be substantially different: for example, North American steel tower Fabricators may implement either American Welding Society (AWS) structural welding standards or *American Society of Mechanical Engineers* (ASME) Boiler and Pressure Vessel welding standards. While it is beyond the scope of this *Recommended Practice* to reconcile the variety of available QA/QC standards, the following sections offer some recommendations that may prove useful.

#### 9.2.1.2.1 Recommendations for Regulatory QA/QC Compliance

Where regulatory compliance with Local Building Code is required, then those test and inspection requirements should apply. Insofar as the IBC serves as the Code basis throughout most of the U.S., compliance with IBC Chapter 17 Special Inspection requirements is recommended for baseline QA/QC criteria. Note that the IBC provisions use AWS/AISC and ACI reference standards for steel and concrete construction, respectively.

In assessing fracture and fatigue of wind turbines with flaws, a widely recognized and acceptable Fracture Mechanics standard is API 579-1/ASME FFS-1 and BS7910: Guide on methods for assessing the acceptability of flaws in metallic structures. Annex E of BS7910 on residual stresses is particularly useful.

#### 9.2.1.2.2 Recommendations for Supplementary QA/QC Compliance

With the exception of required, mandatory regulatory standards, all other QA/QC standards (such as those from Certification Agency Guidelines, *turbine manufacturer* specifications, etc.) may be considered to have supplementary status as either commercial or contractual requirements. It is imperative that some coordination effort be undertaken among project parties to establish the extent to which all other supplementary QA/QC requirements become part of the project requirements.

#### 9.2.1.2.3 Recommendations for Alternative QA/QC Compliance

The term "alternative QA/QC" as used herein refers to otherwise supplementary requirements that are proposed in lieu of required standards, of which a common example routinely encountered in industry practice is the use of International standards in lieu of U.S. standards. In such cases, it is recommended that the *Engineer* provide review and approval in accordance with the "alternative means" or "rational methods" provisions found in most standards. Ultimately, use of alternative standards would require the acceptance of the Authority Having Jurisdiction. While there is no guarantee of agreement, it is assumed that in most cases, the Authority Having Jurisdiction will defer to the judgment of the *Engineer* supported by adequate documentation to justify a rational substitution of standards. In particular, the Authority Having Jurisdiction should

be advised that it is the position of this Recommended Practice that the European (i.e., Eurocode) QA/QC standards are: proven in the European wind industry; unofficially “proven” in the U.S. wind industry; and serve as standards for projects in many parts of the civilized world. Therefore, in terms of quality and safety, the International standards should not be viewed with suspicion, but rather as a source of competent and proven “as-equal” standards with minor technical differences.

### 9.2.1.3 Handling

Tower components should be handled with care in a workmanlike manner. Avoiding even minor damage is critically important with manufactured fabricated tube towers that are thin-shell structures known to be sensitive to local buckling and are subject to high-cycle fatigue loading. For example, a small dent that would otherwise be ignored as insignificant in other steel structures may actually be a pre-buckled condition to structural failure. Also, the tower is a fatigue loaded structure that is sensitive to notches and discontinuities. A scratch or gouge to the tower shell that would otherwise seem minor may be a stress riser or early corrosion location that could serve as a fatigue and fracture crack initiation point, greatly reducing the tower’s fatigue life. All permanent markings on towers and the method of marking should be approved by the *Engineer*. Permanent tower markings done by embossing (stamp impression) in the steel plate should be made with approved rounded “low-stress” stamps. Existing permanent marks made by unknown or unverifiable methods should be considered as deep defects and repaired by a combination of welding and grinding at the approval of the *Engineer*. These and other defects, damage, and repairs in WTGS towers are described in [Agbayani, 2009].

Lifting apparatus such as lifting lugs, spreader bars, temporary tower braces, etc., should be configured to provide adequate support to the lifted tower components and also to minimize and distribute concentrated loading to the lifting points (i.e., “pick points”). Care should also be taken to prevent damage to finished surfaces.

### 9.2.1.4 Storage

Tower sections should be stored in such a way to prevent corrosion or finish damage and to prevent the build-up of moisture, snow, or mud in the tower interior. Care should be taken to protect from corrosion any raw metal surfaces or designated electrically conductive surfaces such as at grounding brackets or flange contact surfaces.

Tower sections should be stored in such a way to prevent excessive concentrated loading. Support points such as flanges should be temporarily braced to prevent excessive or permanent deformation, unless a properly substantiated engineering analysis has determined that no temporary bracing is necessary.

## 9.2.2 Tower Installation

For the organizational purpose of this Guideline, tower transport is classified as part of tower installation. It is recognized, however, that the tower transport and shipping logistics going from the factory to the project site may fall under other than the Fabricator’s or erection Contractor’s responsibility.

Prior to tower installation, the following items should be verified:

- Access path to each tower site to prevent physical damage to tower structure during transport and installation
- Visual inspection of tower structure condition and protective coating following arrival on site.
- Inspection of calibration records for bolt tensioning equipment used to install rods in foundation to tower connection, flange ring bolts between tower sections and other bolts tensioned.

- Bolt tensioning procedures, including sequencing and field bolting records.
- Bill of materials supplied with turbine structure should be fully reviewed and individual components checked off prior to acceptance with the transportation group.
- Anchor bolt pattern configuration should be confirmed and within acceptable limitations prior to erection of the turbine structure.

#### **9.2.2.1 Transport**

Any QA/QC tower inspections required prior to shipping from the factory should be performed prior to transport. The undamaged condition of tower components should be deliberately established and then clearly documented in coordination with the Fabricator. Insofar as transport insurance is a hedge against economic loss due to transport damage, it still should be proven that the damage occurred during transport rather than during handling at the factory.

In general, the discussion in the previous tower “Handling” section should apply. Resultant forces and reactions on the tower sections should be minimized and distributed to prevent excessive concentration. Care should be taken to protect the tower finish during transport. Shipping supports (e.g., shipping “feet” fixtures, shipping braces, straps, etc.) should meet prescribed design shipping forces and accelerations. Legal, safety, and logistical parameters fall under the responsibility of the tower transport Contractor.

Care should be taken to prevent damage to tower internal components during transport. Factory-mounted internal components (e.g., ladders, platforms, cable trays, or separate packages shipped within, etc.) should be secured against loosening, swinging, shifting, or falling off during transport.

Heavy items such as platforms should be securely braced or blocked against excessive movement during transport. Factory-mounted platforms (which typically occur near section splice flanges) should not unintentionally serve as a tower stiffening diaphragm during transport. Dedicated temporary shipping braces should be used to prevent excessive deformation of tower flanges and tower cross sections during transport.

#### **9.2.2.2 Project Site Storage**

In general, the discussion in the previous tower “Storage” section should apply. However, in contrast to storage at a factory yard, it is recognized that shorter term storage at a project site may utilize temporary bracing or support assemblies that are less robust than those used in the factory yard. Nevertheless, any short term field assemblies should meet all necessary functional and safety requirements.

#### **9.2.2.3 Erection**

The erection Contractor is responsible for the means and methods of the tower erection. Crane requirements, lifting rigging and apparatus, and safety requirements should be determined by the Contractor. Use of spreader bars, engineered lifting lugs, and temporary flange braces are recommended to prevent the misshaping of flanges. All previous discussions regarding tower “Handling” should apply. The following are issues affecting tower design that can arise specifically during the tower erection process:

- Dents, finish/coating damage, impact, etc.
- Lack of bolt hole fit-up at splice flanges.
- Lack of initial heel contact at splice flanges.
- Residual flange gaps exceeding agreed tolerance.
- Broken high-strength bolts at splice flanges.



- Tower misalignment (out-of-plumb).
- Excessive cross-wind vibration (due to vortex shedding).

All of the above issues affect the tower design life or factors of safety and should be subject to engineering review to determine what repair or mitigation is necessary.

Any QA/QC inspections required just prior to or during erection should be performed at this stage. In particular, the inspection and testing of high-strength bolting should be coordinated between the *Code*-required Special Inspector and the Contractor. The recommended best practice in the U.S. for validating the torque-to-tension relationship is using the AISC/RCSC requirement for use of a torque-tension calibration method. This can be achieved, for example, through a Skidmore-Wilhelm bolt tension calibrator. The alternative use of the European torque-only method should be at the approval of the *Engineer* and the AHJ, as this falls outside of existing U.S. code practice. It is recommended that the *Engineer* establish the project QA/QC requirements with respect to any use of alternative means of inspection and testing.

#### 9.2.2.4 Tower Cross-Wind Vibration during Erection

Cross-wind vibration, particularly, vortex shedding may be considered a construction phase issue affecting tower erection. The means and methods of tower erection and erection load cases are not typically considered to be part of the primary tower design scope. These provisions should not be construed to make vortex shedding calculations a mandatory part of the tower primary design calculations. Vortex shedding should be considered in accordance with Certification Agency Guidelines, where applicable.

The critical wind speeds for vortex shedding should be calculated for susceptible tower configurations. These include all incomplete tower section configurations during tower erection, e.g., base section alone erected, two sections erected, three sections erected, etc.

Configurations consisting of a completed tower plus a mounted partially or fully assembled wind turbine may also be considered for critical wind speed. Time period for fatigue loading from vortex shedding may be in accordance with [GL, 2003]. Calculation of fatigue loading due to vortex shedding may be in accordance with [ASME, 2006] or [DIN 4133].

### 9.3 Foundation Construction

The success of foundation designs are contingent on verification of soil and conditions assumed during the structural and geotechnical design. This is primarily accomplished through a quality assurance/quality control program carried out during the construction phase of the project. To that end, the following items should be verified during construction, as applicable:

- Soil and bedrock conditions beneath the foundation
- Soil and subgrade shear strength
- Geologic conditions
- Concrete and grout compressive strength
- Backfill shear strength
- Backfill unit weight

The following procedures may be used for construction control and verification of consistent material strength of foundation subgrades and backfills.

- ASTM D 6938 Standard Test Method for In-Place Density and Water Content of Soil and Soil-Aggregate by Nuclear Methods

### 9.3.1 Concrete and Grout

Concrete works should be in general conformance with the following codes and specifications, and all such requirements of the *Engineer*:

- ACI 318 Building Code Requirements for Structural Concrete
- ACI 301 Specifications for Structural Concrete
- ACI 309R Guide for Consolidation of Concrete
- ACI 201.2R Guide to Durable Concrete
- ACI 305R Hot Weather Concreting
- ACI 306R Cold Weather Concreting
- ACI 207.1R Guide to Mass Concrete
- ASTM C 94 Standard Specification for Ready-Mixed Concrete
- ACI 351.1R-99 Grouting between Foundation and Support of Equipment and Machinery
- ACI 351.3R-04: Foundations for Dynamic Equipment

### 9.3.2 Concrete Durability Requirements

Concrete mix design should be in accordance with ACI 318 and take into account the following factors:

- Water-cementitious material ratio
- Freezing and thawing exposure
- Sulfate exposure
- Corrosion protection of reinforcement

### 9.3.3 Anchor Bolts

Anchor bolt material selection should consider toughness requirements as may be specified by the WTGS Supplier and/or in consideration of cold temperatures at the project site.

### 9.3.4 Reinforcement

Concrete reinforcement should be fabricated and installed in accordance with ACI 318.

### 9.3.5 Concrete Placement

Concrete should be placed in accordance with ACI 318 and as recommended in ACI 309R.

### 9.3.6 Geotechnical Testing

The following testing should be considered to confirm design basis and parameters obtained at early stages during geotechnical studies.

ASTM D 6938 may be used to verify subgrade moisture content and density, and for verification of density, moisture content and relative compaction of fills.

Torvanes and Pocket Penetrometers may be used to estimate the shear strength of cohesive soils during construction. They should generally be used for comparison of relative strength since they yield only approximate shear strength data and should not be used in foundation design.

Portable static and dynamic cone penetrometers may be used to evaluate shear strength and relative density of subgrade and fill materials. They are also useful for comparison of relative subgrade strength such as in identifying relatively soft zones within foundation excavations.

Plate load testing may be performed to determine bearing capacity and settlement characteristics for shallow foundations. Correction factors should be applied to account for the footing size to be utilized since the testing is done with relatively small bearing areas.

### **9.3.7 Concrete Testing**

Concrete testing should be performed at the job site in accordance with ACI 318 and by qualified testing technicians. At a minimum, the following should be performed:

- Obtain concrete cylinders for curing under field conditions and for subsequent testing in the laboratory
- Slump
- Temperature
- Air content (if applicable)

### **9.3.8 Anchor Bolt Tensioning**

Anchor bolts should be post-tensioned to tension values and sequence specified by the *Engineer* utilizing calibrated equipment. Unless otherwise specified by the *Engineer*, following completion of tensioning of all bolts for a turbine, a tension check should be performed on a random 10% of the anchor bolts. Tensioning records should be kept for initial tensioning and subsequent verification testing.

## 10 Operations, Inspections and Structural Health Monitoring

### 10.1 Scope

This section addresses the post-construction inspection of the steel tower structure and foundation elements and health monitoring during the life of the structure.

### 10.2 Commissioning Activities

The *turbine manufacturer* provides to the owner design requirements for safe operation, inspection and maintenance. Upon *Commissioning* this information includes:

- Instructions concerning *Commissioning* for operations and maintenance
- Energization (non-structural)
- *Commissioning* tests
- Records including weld inspection reports, flange bolt tensioning, material certifications and warranty documents related to products incorporated into the tower structure
- A service manual and maintenance manual
- Work procedures plan
- Emergency procedures plan including OSHA guidelines for fall arrest and rescue.

Once the wind turbine tower is commissioned, the owner assumes responsibility for maintaining the structure in accordance with the *Commissioning* documents provided by the *turbine manufacturer*.

### 10.3 Post Construction Inspections – Towers

The structural components of wind turbine towers are inspected at the minimum time intervals required by the *Turbine Manufacturer* and Certification Agency. Inspection time intervals will vary by component and location to account for higher corrosive environments. International Building Code (IBC), Chapter 17 Structural Tests and Special Inspections should also apply to this section as required by the *Engineer*. Mill, fabrication and welding certifications of the tower materials are maintained by the *Turbine Manufacturer* and not addressed in this section.

#### 10.3.1 Tower Structure

The following minimum items are recommended to be inspected or monitored:

- Structural connections of climbing facilities, platforms, and other supporting systems on tower
- Bolt retensioning records
- Physical condition of bolt and nut locking devices
- Paint coatings, epoxy and/or galvanizing condition of all tower components
- Straightness of tower structure and movement of soil adjacent to foundation perimeter

Long term retensioning frequency will vary by the Tower Manufacturer and will typically be recommended in the Tower Manufacturer's service manual.

#### 10.3.2 Bolted Connections

Bolt inspections are performed using calibrated equipment to verify that correct tension exists in bolts following their balancing, steel grade and condition of bolts. To prevent premature degradation of the structural elements at the locations of the bolted connections, an ongoing routine inspection program that includes the Tower Manufacturer is recommended. This inspection program takes into account the steel relaxation associated with bolt lengths, testing methods (ping testing, others), and connection types. The bolted connections between the Tower and a

grouted base connection interface with the Foundation are particularly critical, as uplifting of the base flange during extreme weather events can result in localized overstress and crushing of the grout and excessive movement. Applicable bolting standards include the Specification for Structural Joints Using A325 or A490 Bolts by the Research Council on Structural Connections Committee A.1 (RCSC)

### 10.3.3 Welded Connections

The Tower Manufacturer maintains and provides records of original mill certifications of steel, ultrasonic or magnetic particle weld inspections, and other quality assurance records that document compliance with the specifications. Any new welding on the tower structure should be inspected using non-destructive testing (NDT) techniques by an AWS certified weld inspector and be performed in accordance with weld specifications outlined in AWS D1.1. It is noted that AWS D1.1 is the Code reference standard, but *American Society of Mechanical Engineers (ASME): Boiler & Pressure Vessel Code* welding standard (ASME BPVC IX) may be used at the discretion of the *Engineer* or AHJ.

Additional information on certification levels for NDT inspectors is available through the American Society for Nondestructive Testing, ASNT.

### 10.3.4 Corrosion Protection and Coatings

Large wind turbine support structures can be protected against the environment during the life of the structure through various technologies. Paint coatings and hot dipped galvanizing are two separate proven technologies. The U.S. specification for galvanizing is ASTM A123 Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products, and ASTM A153 Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Hardware. Paint coatings are applied in fabrication in accordance with ISO-12944-2: 1998 Standards for corrosion protection of steel structures by protective paint systems. Damage to any coating of the tower structure is important to repair upon discovery.

It is equally important that corrosion protection of the tower base anchor bolt post-tensioning is achieved. This starts during the installation process when the post-tensioning bolts should be sealed and kept dry. A protective external coating of the exposed bolts prior the placement of the tower and tensioning is recommended.

## 10.4 Post construction Inspections - Foundations

Foundation elements are partially or fully buried below grade, requiring these concrete elements to be inspected both prior to, during and after their construction. This section addresses the element of the foundation above grade.

The following minimum items are recommended to be inspected or monitored:

- Visible cracks in the above-grade portion of concrete foundation
- Concrete degradation or cracking in exposed foundation
- Visible inspection of the condition of the grout for cracking or spalling
- Settlement of tower foundation or surrounding soil

Concrete cracking in the foundation elements should be examined by the engineer to establish cause. Repair of surface cracking, when not indicative of a structural concern, is recommended to repair to reduce the ingress of water and elements that can cause corrosion and reduce the designed life cycle of the foundation element.

Non-destructive testing technologies that may be required to verify the condition of the foundation when damage occurs are varied and selected based on the location on foundation, density of local reinforcing steel and site constraints.

Guidelines of concrete inspection procedures are provided by the American Concrete Institute (ACI), Post-Tensioning Institute (PTI) and the Prestressed Concrete Institute (PCI). It is

recommended that the Engineer of Record (EOR) provide inspection and non-destructive testing criteria for the foundation during the service phase of the turbine's life. These inspections may include frequency of concrete and grout inspection, anchor bolt testing for tension and condition surveys to establish level of any corrosion of the structural elements. ,

### **10.5 Structural Health Monitoring**

Sensors may be used to monitor the structural behavior of the wind turbine structure. The tower structure can be monitored for localized fault finding, tilt and vibration intensity. The primary methods of health monitoring include accelerometers, velocity meters, displacement measurement and strain gauges. Accelerometers are used to measure the dynamic response and natural frequencies of the tower and can detect signs of changes in the structure. Strain gauges and other displacement measuring devices detect highly localized changes in the structures condition. The application of strain gauges are often used in prototype towers. Sensors are not commonly used in production towers.

### **10.6 Life Cycle**

The life cycle of a wind tower structure can be extended through preventive visual inspections at the time of its installation to assure all elements are properly installed and post construction inspections.

## 11 References

- AA, "Aluminium Design Manual", *Aluminium Association*, 2000
- ACI 201.2R-01, Guide to Durable Concrete, ACI Committee 201, technical committee document 201.2R, 2001
- ACI 207.1R-96, Mass Concrete, ACI Committee 207, technical committee document 207.1R-96, 1996
- ACI 301-05, Specifications for Structural Concrete, 2005
- ACI 305R-99, Hot Weather Concreting, ACI Committee 305, technical committee document 305R-99, 1999
- ACI 306R-88, Cold Weather Concreting, ACI Committee 306, technical committee document 306R-8, 1988
- ACI 309R, Guide for Consolidation of Concrete, ACI Committee 309, technical committee document 309R-05, 2005, 35 pp.
- ACI 351.1R-99, Grouting for Support of Equipment and Machinery, ACI Committee 351, technical committee document 351.1R-99, 1999
- ACI 351.3R-04, Foundations for Dynamic Equipment, ACI Committee 351, technical committee document 351.3R-04, 2004
- ACI, "Building Code Requirements for Structural Concrete", ACI 318, *American Concrete Institute*, 2008
- ACI, "General Code References", *American Concrete Institute*, Farmington Hills, MI
- ACI, "Building Code Requirements for Structural Concrete", *ACI 318M-95 and Commentary ACI 318RM-89*, 1993
- Agbayani, "Defects, Damage, and Repairs Subject to High-cycle Fatigue: Examples from Wind Farm Tower Design," *Proceedings of the Fifth Congress on Forensic Engineering, American Society of Civil Engineers (ASCE)*, Reston, Virginia, 546-555. 2009
- AISC, "Steel Construction Manual", 13th Edition, *American Institute of Steel Construction*, 2005
- API 579-1/ASME FFS-1, Fitness-For-Service, Second Edition, American Petroleum Institute, 2007
- ASCE 7-05, "Minimum Design Loads for Buildings and Other Structures", SEI/ASCE 7-05. *American Society of Civil Engineers*, 2005
- ASME BPVC IX, ASME Boiler and Pressure Vessel Code (BPVC) Section IX-Welding and Brazing Qualifications, 2010
- ASME, "ASME STS-1-2006 Steel Stacks", *American Society of Mechanical Engineers*. New York, NY, 2006
- ASTM A123, Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products, 2009
- ASTM A770 / A770M - 03 Standard Specification for Through-Thickness Tension Testing of Steel Plates for Special Applications, 2007
- ASTM C94, Standard Specification for Ready-Mixed Concrete, 2011
- ASTM D6938, Standard Test Method for In-Place Density and Water Content of Soil and Soil-Aggregate by Nuclear Methods (Shallow Depth), 2010
- ASTM E1049-85(2011), Standard Practices for Cycle Counting in Fatigue Analysis, 2011
- ASTM E1820-11, Standard Test Method for Measurement of Fracture Toughness, 2011
- ASTM, "Material Specifications", *ASTM International*, West Conshohocken, PA

AWS D1.1, AWS D1.1/D1.1M:2010: Structural Welding Code- Steel, 2010

Barnes D. W. and Mangelsdorf C. P., "Allowable Axial Stresses in Segmented Columns", Engineering Journal, *American Institute of Steel Construction*, 1<sup>st</sup> Quarter, 1979

CEB/FIP Model Code, "Fatigue design of concrete structures", The CEB/FIP Model Code for Concrete Structures, *the Comite Euro-International du Beton as Bulletins d'Information*, 1990

DAST Guideline 021, German specification similar to EN 14399-4 for larger bolts (M39 to M64).

DIN 18800, "German code for the design of structural steel", Germany, 1990

DIN 4133/EN 13084, Free-standing chimneys. General requirements, 2007

DNV, "Fatigue Design of Offshore Steel Structures", DNV-RP-C203, 2007

DNV/Risoe, 2002, Guidelines for Design of Wind Turbines – DNV/Risø, 2002.

EN 10025-2, European structural steel standard EN 10025-2, Part 2: Technical delivery conditions for non-alloy structural steels, 2004

EN 10025-3, European structural steel standard EN 10025-3, Part 3: Technical delivery conditions for normalized/normalized rolled weldable fine grain structural steels, 2004

EN 14399-4, High-strength structural bolting assemblies for preloading - Part 4: System HV - Hexagon bolt and nut assemblies, 2005

EN 1993-1-1, Eurocode 3, Design of steel structures - Part 1-1: General rules and rules for buildings, 1993

EN 1993-1-10, Eurocode 3: Design of steel structures - Part 1-10: Material toughness and through-thickness properties, 2005

EN 1993-1-6, Eurocode 3, Design of steel structures - Part 1-6: Strength and stability of shell structures, 1993

ENV (2002), "Prestandard prEN" 1993-1-9:2002

Eurocode 2, BS EN 1992-1-1:2004 "Design of concrete structures". *General rules and rules for buildings*

Eurocode 3, "Design of Steel Structures – Part 1.9: Fatigue Strength of Steel Structures", *European Committee for Standardization (CEN)*, Brussels, Belgium. 2002

Faber T. and Dalhoff P., "Dynamic Behaviour of Oil Dampers in Wind Turbine Towers", *Germanischer Lloyd WindEnergie GmbH*, Hamburg, Germany, 2008.

FHWA, "Drilled and Grouted Micropiles State-of-the-Practice Review", *Federal Highway Administration*, 1999

Frese T. and Dalhoff P., "Fatigue Analysis of Bolted and Welded Joints", Practical Experience in Type Certification of Wind Turbines, *Proceedings of the NAFEMS Seminar*, Wiesbaden, Germany, 2000

Galambos T. V., Editor, "Guide to Stability Design Criteria for Metal Structures", 5th Edition, *John Wiley & Sons, Inc.*, New York, NY, 1998

GL, "Rules and Guidelines, IV–Industrial Services", Part 1–Wind Energy, Guidelines for the Certification of Wind Turbines, *Germanischer Lloyd Wind Energie GmbH*, Hamburg, Germany, 2003

IBC, "International Building Code", *International Code Council (ICC)*, Country Club Hills, Illinois, 2009

IEC 61400-22, Conformity testing and certification, International Electrotechnical Commission, 2011

IEC, "International Standard IEC 61400-1", Wind Turbine Generator Systems–Part 1: Safety Requirements, Third Edition, *International Electrotechnical Commission*, Geneva, Switzerland, Edition 3, 2005



IIW, "Recommendations for Fatigue Design of Welded Joints and Components", Document XIII-1965-03/XV-1127-03, International Institute of Welding (German Delegation), Paris, France, 2003

ISO 12944-2, Paints and varnishes -- Corrosion protection of steel structures by protective paint systems -- Part 2: Classification of environments, 1998

ISO 4354 (2009), Wind actions on structures, International Organization for Standardization, Second Edition, 2009

Keating and Fisher (1986), Evaluation of fatigue tests and design criteria on welded details, 1986

NCHRP Report 412, Fatigue-Resistant Design of Cantilevered Signal, Sign and Light Supports, Transportation Research Board, 1998

NCHRP Report 507, Load and Resistance Factor Design (LRFD) for Deep Foundations, 2004

Newmark N., "Numerical Procedure for Computing Deflections, Moments, and Buckling Loads", Paper 2202, ASCE, Vol. 108, 1943

PCI, "Industry Handbook Committee", *PCI Design Handbook: Precast and Prestressed Concrete*. 5th ed., MNL-120-99, Chicago, IL: PCI, 1999

Petersen C., "Fatigue Assessment of Eccentrically Loaded Ring Flanges", *Stahlbau* 67 Book 3, 1998

Prowell, I., *An Experimental and Numerical Study of Wind Turbine Seismic Behavior*, PhD dissertation, University of California, San Diego, 2011

PTI, "Recommendations for Prestressed Rock and Soil Anchors", PTI Committee for Prestressed Rock and Soil Anchors, 2005

Schmidt H. and Neuper, M., "Elastic-static Behaviour of Eccentrically Tensioned L-connections with Prestressed Bolts", *Stahlbau* 66, Book 3, 1997

Seidel M., "Dimensioning of Bolted Ring Flange Connections of Wind Turbines", *Institute for Steel Construction*, Dissertation, Book 20, University of Hannover, 2001

Troitsky M. S., "Tubular Steel Structures" - Theory and Design, Second Edition, James F. *Lincoln Arc Welding Foundation*, Cleveland, Ohio, 1990

## 12 Appendix A: Large Wind Turbine Structural Compliance Checklist

The following Checklist is offered as a recommended verification list to be used by Authorities Having Jurisdiction involved in the permitting process as it relate to wind turbine structural integrity. Statements or PE-stamped documentation should be accompanied, as needed, by Assessments (itemized below in 3 - 9). Itemized Assessments below (3 – 9) should be performed by reputable Independent Engineer(s). This Checklist can be used for entire wind farms or individual wind turbines. Local site-specific conditions should be assessed as per this RP.

\_\_\_ 1. Statement or certification of wind turbine (**rotor-nacelle assembly**) compliance meeting at least one of the following:

\_\_\_ 1a. Statement indicating local site-specific conditions meets those assumed for the design of wind turbine(s) as per conditions in Section 11 of IEC 61400-1.

\_\_\_ 1b. Statement indicating structural integrity of wind turbine is not compromised under local site-specific conditions when these conditions equal or exceed those assumed in design of wind turbine. Should also fulfill Item #10 below.

\_\_\_ 2. PE-stamped calculations and drawings that show design code compliance of support structure (**tower and foundation**) is not compromised under local conditions for wind turbine to be installed. Should also fulfill Item #11 below.

The following Independent Evaluations refer to Section 11 of IEC 61400-1 and this *Recommended Practice*, as may be required for a given wind farm project:

\_\_\_ 3. Assessment of topographic complexity (if any)

\_\_\_ 4. Assessment of wind conditions

\_\_\_ 5. Assessment of wake effects from neighboring wind turbines

\_\_\_ 6. Assessment of other environmental conditions

\_\_\_ 7. Assessment of earthquake conditions

\_\_\_ 8. Assessment of soil/geotechnical conditions

\_\_\_ 9. Assessment of structural integrity by load calculations by Professional Engineer (**if Items #1 or #2 above are not marked**)

\_\_\_ 10. Rotor-nacelle assembly component verification report or certification (**when Item #1b above is marked**)

\_\_\_ Load cases or special design situations

\_\_\_ Load calculations

\_\_\_ Fatigue Loads

\_\_\_ Ultimate Loads

\_\_\_ Load carrying component capacity, buckling and deflection analyses

\_\_\_ 11. Support structure design documentation or verification report (**when Item #2 above is marked**)

\_\_\_ Load cases or special design situations

\_\_\_ Load calculations

\_\_\_ Fatigue Loads

\_\_\_ Ultimate Loads

\_\_\_ Load carrying component capacity, buckling and deflection analyses

### 13 Appendix B: Loads Document Sample Format

In the wind industry standard practice, the *Loads Document* has evolved into an efficient way to communicate *WTGS* loads to *Certification Agencies* and to component designers, such as tower or foundation design engineers. While there is no industry standard for *Loads Document* report formatting, the required content of most loads documents is somewhat uniform. The focus of this section is to identify specific information found in loads documents that is especially useful to perform the structural design of the *WTGS* support structure.

#### Recommended Content:

- Geometric Parameters including:
  - Coordinate axis definitions, i.e., the X-Y-Z used as reference
  - Tower hub vertical offset dimension above tower top
  - Maximum permissible tower diameter at the blade tip pass elevation
  - Required ring flange geometry at the turbine base-to-tower mounting interface
- Parameters for Transport and Erection Logistics:
  - Maximum permissible diameter for any tower section
  - Maximum permissible weight for any single tower section
  - Maximum permissible length for a tower section
- Turbine Parameters:
  - Turbine mass properties including
    - Center of gravity (C.G.) coordinates of the total turbine and also of individual components such as the nacelle and rotor (hub and blades).
    - Weight of the total turbine and also of individual components such as the nacelle and rotor (hub and blades).
    - Mass moments of inertia about the turbine C.G.
  - Turbine operating frequencies (speeds), the range of operating frequencies, distinct operating frequencies (e.g., where separate high and low speed generators exist), and any other operational frequencies significant for the tower designer to avoid resonance by providing adequate separation from the *WTGS* turbine-tower-foundation system natural frequencies.
- Tower Loads (clearly designating both unfactored characteristic (i.e., “service”) loads and factored design loads) including
  - Envelope of governing extreme loads
  - Envelope of DLC 6.1 cases for *local building code* compliance.
  - Envelope of operational load cases to be used in the earthquake load combinations.
- Fatigue loads including:
  - Fatigue Damage Equivalent Loads at the tower top, base, and preferably at several intermediate elevations such as at splice flange locations.
  - Fatigue Loads in Markov matrix format at the top flange, base plate, and intermediate splice flange elevations.
    - Fatigue Loads in Markov matrix format at other tower locations as requested by the *Engineer* where fatigue design procedures are such that damage equivalent loads are not sufficient.

Sample Format

*Extreme Loads*

EXTREME LOADS											
		$F_x$	$F_y$	$F_z$	$F_{res}$	$M_x$	$M_y$	$M_z$	$M_{res}$	Load Case	Load Factor
$F_x$	Max										
	Min										
$F_y$	Max										
	Min										
$F_z$	Max										
	Min										
$F_{res}$	Max										
	Min										
$M_x$	Max										
	Min										
$M_y$	Max										
	Min										
$M_z$	Max										
	Min										
$M_{res}$	Max										
	Min										

*Fatigue Damage Equivalent Loads*

FATIGUE DAMAGE EQUIVALENT LOADS							
Nref		$F_x$	$F_y$	$F_z$	$M_x$	$M_y$	$M_z$
m is the slope parameter of the S/N curve	$m_a$						
	$m_b$						
	$m_c$						
	$m_d$						
	$m_e$						
	$m_f$						
	$m_g$						
	$m_h$						
	$m_i$						
	$m_j$						

## 14 Appendix C: ASCE 7-05 versus IEC 61400-1 extreme velocity and turbulence profiles

To relate the extreme wind speed profiles in ASCE7-05 and IEC61400-1 the following manipulations are required.

For ASCE 7-05 and older versions, the Basic Wind Speed ( $V$ ) is the 3 second gust speed at 10m height in flat open terrain with a Mean Recurrence Interval of 50 years. To determine gust wind speeds at other heights  $V(z)$ , ASCE7-05 Table 6-3 is used which is based on the equation:

$$V_{ASCE}(z) = V\sqrt{K_z} = 1.4V\left(\frac{z}{z_G}\right)^{1/\alpha} \quad (\text{SI Units}) \quad (\text{Eq C5-1})$$

Where  $\alpha$  is the power law exponent and  $Z_G$  the 'gradient height or nominal height' of the boundary layer as shown in Table C5-1 below and are functions of different terrain roughness B = urban, C = open country, D = very flat shallow water.

The turbulence intensity, being the ratio of the standard deviation of longitudinal velocity fluctuation to the hourly mean wind speed is given by:

$$I_{ASCE}(z) = \frac{\sigma_1}{V_{ASCE}} = c\left(\frac{10}{z}\right)^{1/6} \quad (\text{SI Units}) \quad (\text{Eq C5-2})$$

To determine the hourly mean wind speed from the 3 second gust wind speed ASCE7-05 uses Equation 6-14 as:

$$\bar{V}_{ASCE}(z) = \bar{b}\left(\frac{\bar{z}}{10}\right)^{\bar{\alpha}} V \quad (\text{SI Units}) \quad (\text{Eq C5-3})$$

Where  $\bar{z}$  is the equivalent height of the structure.

**Table C5-1.** Coefficients for ASCE 7 Velocity and Turbulence Intensity Profiles

ASCE 7 Exposure Category	$\alpha$	$\bar{\alpha}$	$\bar{b}$	c	$z_G$ (m)
<b>B</b>	7	1/4.0	0.45	0.30	366
<b>C</b>	9.5	1/6.5	0.65	0.20	274
<b>D</b>	11.5	1/9.0	0.80	0.15	213

The IEC61400-1 reference wind speeds are in terms of a 10 minute wind speed ( $V_{ref}$ ) at hub height with a Mean Recurrence Interval of 50 years. The extreme wind speed ( $V_{e50}$ ) is the 3-second gust speed with a 50 year Mean Recurrence Interval and is related to the reference wind speed and for different heights by Equation (12) in IEC61400-1:

$$V_{e50}(z) = 1.4V_{ref}\left(\frac{z}{z_{HUB}}\right)^{0.11} \quad (\text{SI Units}) \quad (\text{Eq C5-4})$$

This can be compared with the gust velocity profile from ASCE7, Equation C5-1 here and is shown in Figure C5-1 for an 80m hub height.

The extreme wind speed standard deviation of turbulence intensity in the longitudinal direction is given by IEC61400-1 Eq (16):

$$\sigma_1 = 0.11V_{HUB} \quad (\text{Eq C5-5})$$

A relationship between the ASCE 7 Basic wind speed ( $V$ , 3 second MRI=50 years) and the IEC61400-1 reference wind speed ( $V_{ref}$ ) can be obtained by manipulating equations C6-1 and C6-4 by determining the 3 second gust speed with MRI=50 years at the hub height. This yields:

$$V_{ref} = V \left( \frac{z_{HUB}}{z_G} \right)^{1/\alpha} \quad (\text{Eq C5-6})$$

IEC61400-1 indicates that the mean wind speed as a function of height is given by:

$$V(z) = V_{HUB} \left( \frac{z}{z_{HUB}} \right)^{0.2} \quad (\text{Eq C5-7})$$

The turbulence intensity profiles for IEC61400-1 can then be calculated as:

$$I_{IEC}(z) = \frac{\sigma_1}{V(z)} = 0.11 \left( \frac{z_{HUB}}{z} \right)^{0.2} \quad (\text{Eq C5-8})$$

This can be compared with Eq C5-2 and is shown in Figure C5-2 for an 80m hub height.

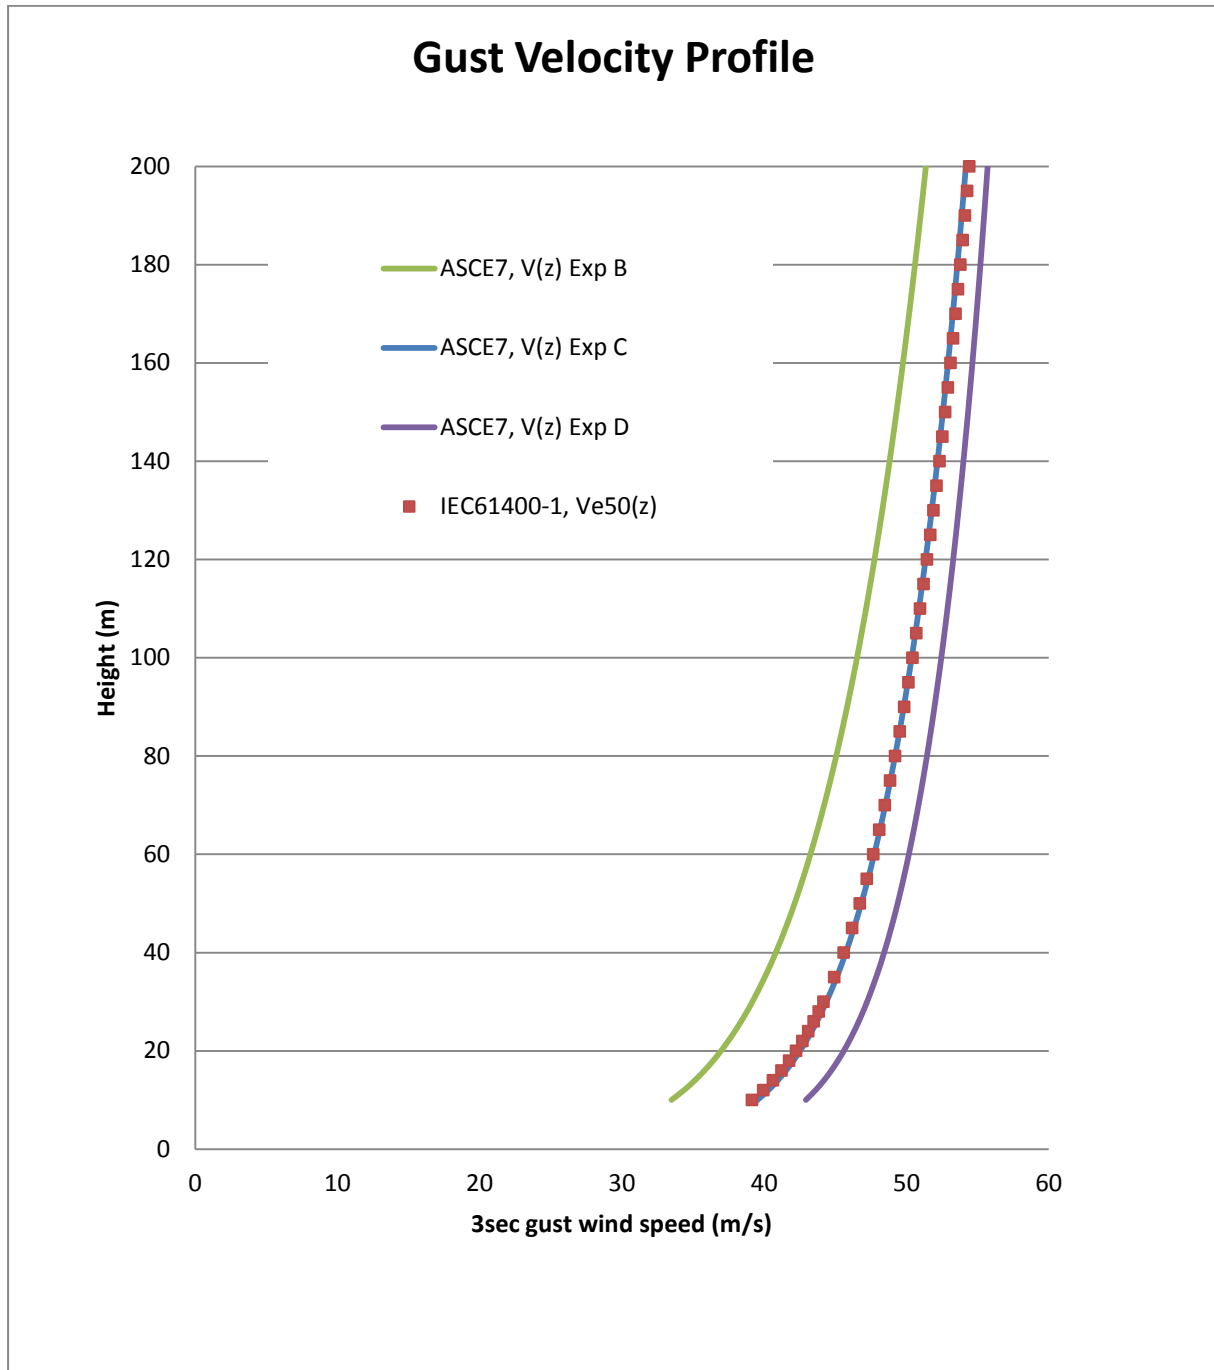


Figure C6.1 Comparison of gust velocity profiles for an 80m hub height

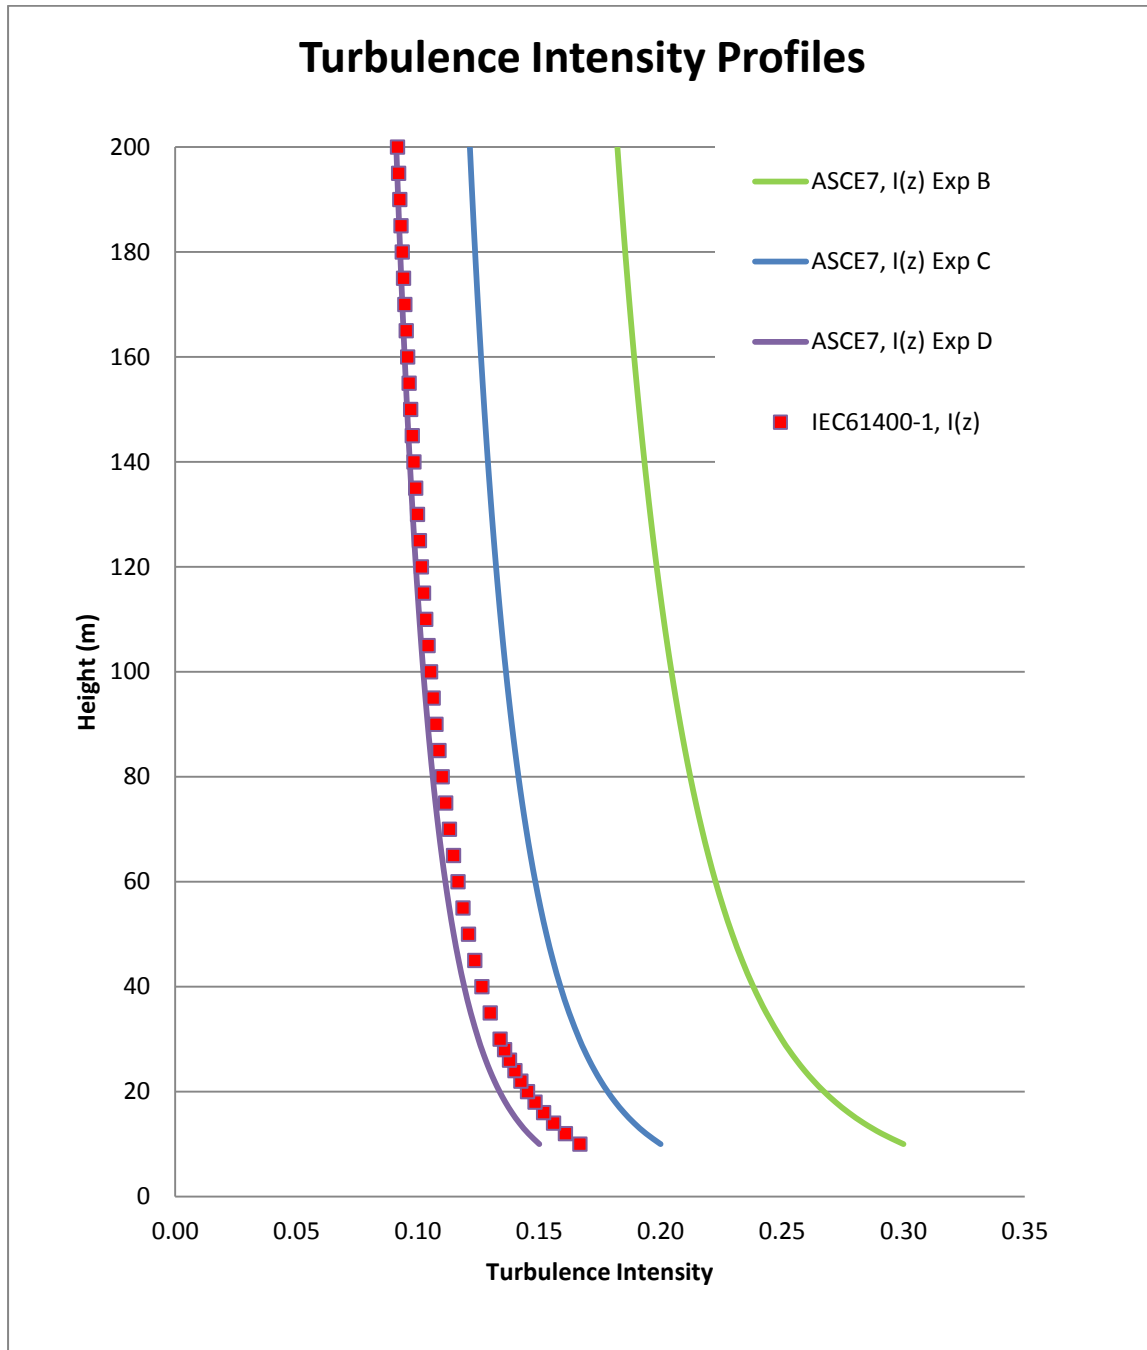


Figure C6.2 Comparison of turbulence intensity profiles for an 80m hub height



